

Structural Design and Foundation Design

ACBA6018

Structural Analysis & Design of a Small Office Building

Timothy Issac Mills

Student Number: 2206144

Submission Date: 01/05/2023

Contents

1) Introduction.....	3
2) Proposed Design Plans of Office Block	4
3) Structural Analysis of Member A.....	6
4) Structural Analysis of Member B.....	10
5) Structural Analysis of Member C.....	14
6) Structural Analysis of Member D.....	18
7) Structural Analysis of Member E	21
8) Structural Analysis of Column A	25
9) Structural Analysis of Base Plate - Column A.....	29
10) Structural Analysis of Connection A – Member C to Column A.....	32
Appendix A – Member A – UB254x146x31	36
Appendix B – Member A – UB305x102x28.....	38
Appendix C – Member A – UB254x102x28 - Check.....	40
Appendix D – Member B – UB305x165x40.....	42
Appendix E – Member B – UB254x146x43	44
Appendix F – Member B – UB305x127x37 - Check	46
Appendix G - Member C - UB533x312x151	48
Appendix H - Member C - UB610x305x149	50
Appendix I - Member C - UB533x312x182.....	52
Appendix J - Member C - UB610x305x179 - Check.....	54
Appendix K - Member D - UB610x305x179 - Check	56
Appendix L - Member E - UB178x102x19	58
Appendix M - Member E - UB203x102x23	60
Appendix N - Member E - UB254x102x22 - Check	62
Appendix O - Column A - UC254x254x107	64
Appendix P - Column A - UC305x305x97	66
Appendix Q - Column A - UC305x305x118 - Check	68

1) Introduction

The project involves the structural analysis for a design of a typical floor layout within a five-storey building. The structural layout consists of a reinforced concrete slab supported by a system of universal steel beams. The objective is to ensure that the selected structural components can safely support all applied loads while complying with relevant design codes and standards.

The floor system is subject to the following characteristic design loads:

- Dead Load - including slab self-weight, steelwork, finishes, ceilings, partitions, services, and fire protection = 6.0 kN/m^2
- Imposed Load (live load) = 4.0 kN/m^2

The total uniformly distributed load acting on the floor is therefore 10.0 kN/m^2 .

All structural steel used will be designed to grade S275 steel. The design will be done in accordance with British Standards 5950.

The purpose of the analysis is to determine the size and arrangement of universal beams required to support the proposed reinforced concrete slab, while aiming for an economical design that minimizes overall project costs and avoids unnecessary oversizing.

The proposed office layout from the architect is shown below:-

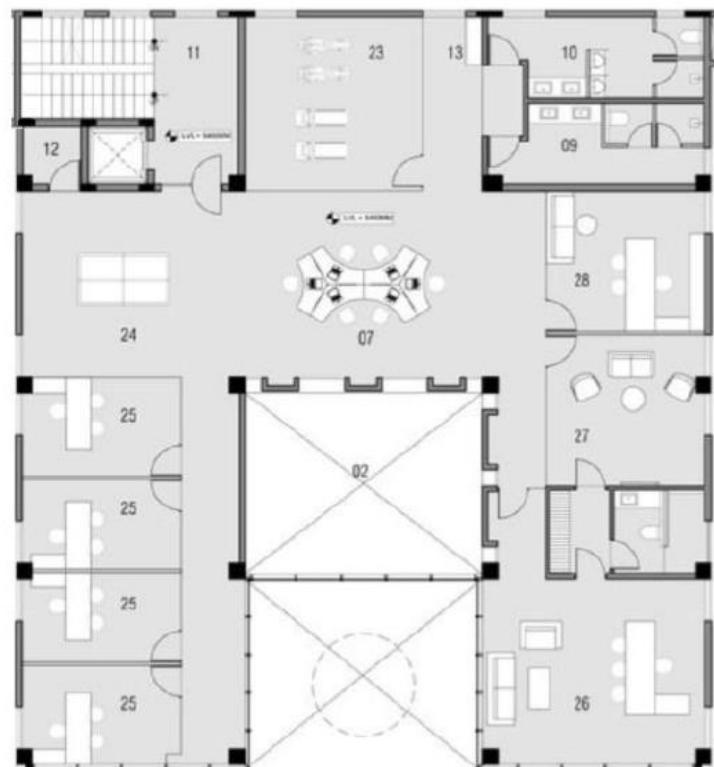


Image 1 - Proposed layout at each level

2) Proposed Design Plans for Office Block

Confirmed member sizes (Refer to section 2c - 2h for analysis):-

Member A = Universal Beam - 254x102x28

Member B = Universal Beam - 305x217x37

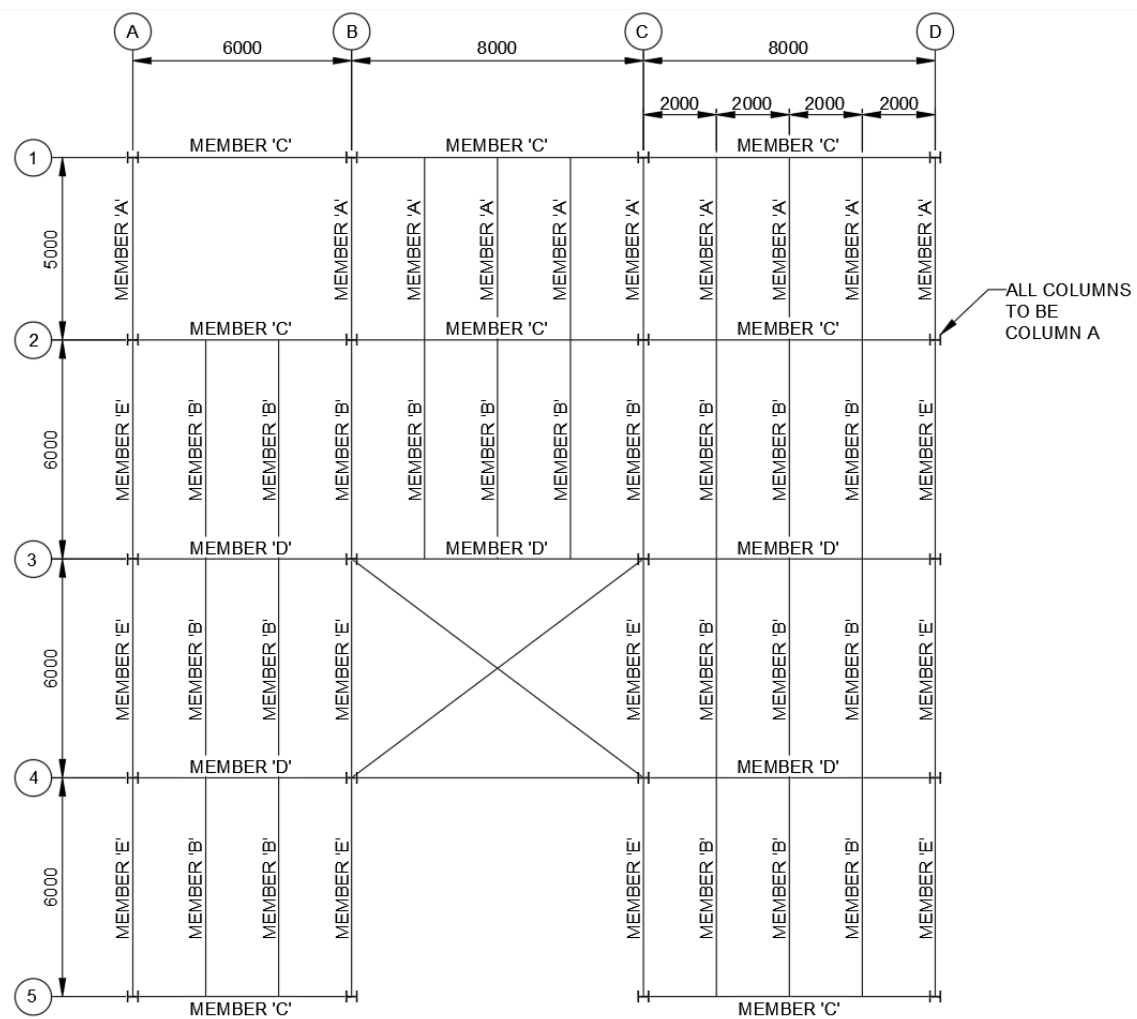
Member C = Universal Beam - 610x305x179

Member D = Universal Beam - 610x305x179

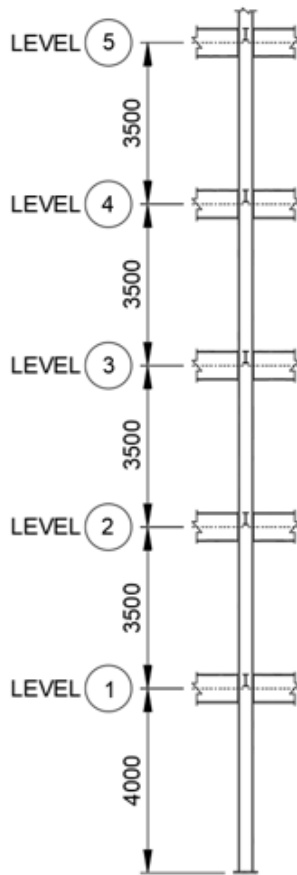
Member E = Universal Beam - 254x102x22

Column A = Universal Column - 305x305

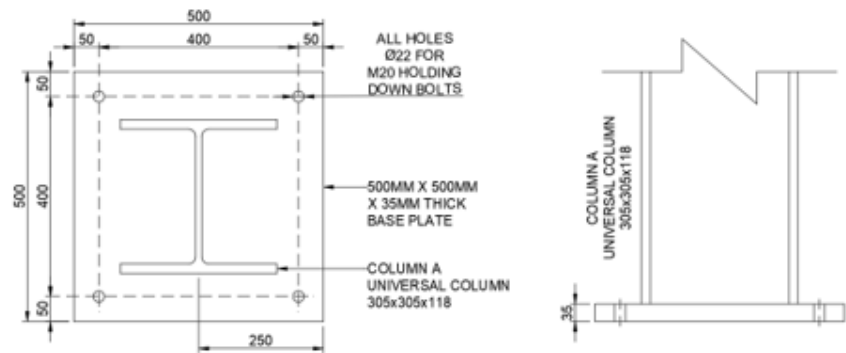
Member layout on plan at Level 1 / 2 / 3 / 4 / 5



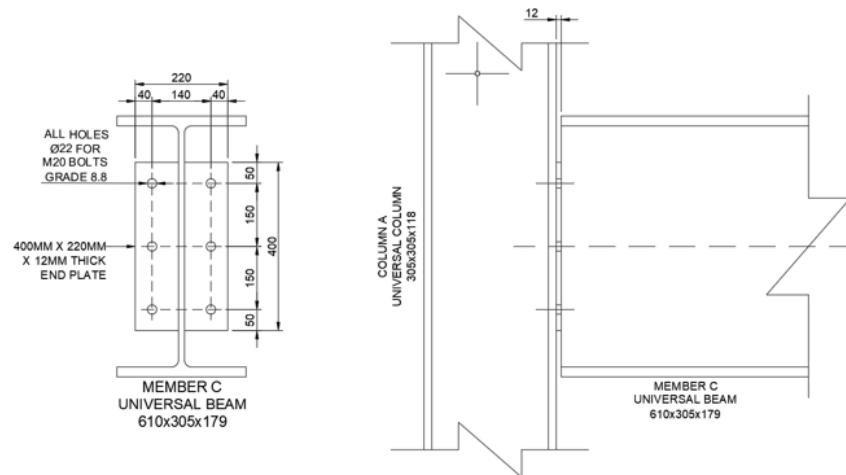
Section View of Column A



Base Plate – Details

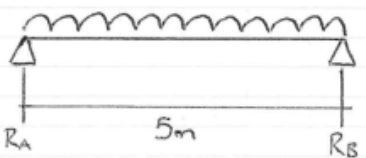


Connection A – Details

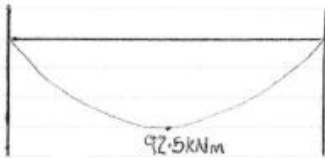
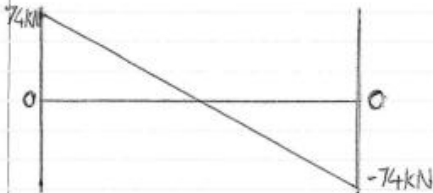


3) Structural Analysis of Member A

	Project		Name	Date
	InSite Project No.		By	TM
	Client Project No.		Chk'd	
	Document No.		App'd	
	Calculation Title	Member A	Sheet	1 of 5

Reference	Calculation	Output
	Load acting on Secondary Member :- Dead Load (g_k) = 6 kN/m^2 Imposed Load (q_k) = 4 kN/m^2 Area acting on Secondary Member = $5 \text{ m} \times 2 \text{ m} = 10 \text{ m}^2$ Total Dead Load (g_k) = $6 \text{ kN/m}^2 \times 2 \text{ m}$ $= 12 \text{ kN/m}$ $g_k = 12 \text{ kN/m}$ Total Imposed Load (q_k) = $4 \text{ kN/m}^2 \times 2 \text{ m}$ $= 8 \text{ kN/m}$ $q_k = 8 \text{ kN/m}$  Calculate Ultimate Load (w) $w = 1.4 g_k + 1.6 q_k$ $w = 1.4 \times 12 \text{ kN/m} + 1.6 \times 8 \text{ kN/m}$ $w = 16.8 \text{ kN/m} + 12.8 \text{ kN/m}$ $w = 29.6 \text{ kN/m}$ $w = 29.6 \text{ kN/m}$	

	Project		Name	Date
	InSite Project No.		By	TM
	Client Project No.		Chk'd	
	Document No.		App'd	
	Calculation Title	Member A	Sheet	2 of 5

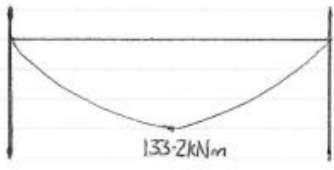
Reference	Calculation	Output
	Design of Moment & Shear $M = \frac{wl^2}{8} = \frac{29.6 \text{ kN/m} \times 5 \text{ m}^2}{8} = \frac{740}{8}$ $M = 92.5 \text{ kNm}$ 	$M = 92.5 \text{ kNm}$
	Maximum Shear at R_A & R_B $R_A = R_B = \frac{wl}{2} = \frac{29.6 \text{ kN/m} \times 5 \text{ m}}{2} = \frac{148}{2}$ $R_A = R_B = 74 \text{ kN}$ 	$R_A = R_B = 74 \text{ kN}$
	Initial Member Selection Steel Grade (p_y) = 275 N/mm^2 $M_c = p_y S_x \Rightarrow S_x \geq \frac{M}{p_y} = S_x \geq \frac{92.5 \text{ kNm}}{275 \text{ N/mm}^2}$ $S_x \geq \frac{92.5 \times 10^6}{275} = S_x \geq 336,363.63 \text{ mm}^3$ $S_x \geq 336.36 \text{ cm}^3$	

	Project		Name	Date
	InSite Project No.		By	TM
	Client Project No.		Chk'd	
	Document No.		App'd	
	Calculation Title	Member A	Sheet	3 of 5

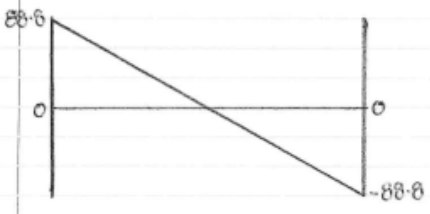
Reference	Calculation	Output																								
BS EN 10025	Initial Member Selection																									
	<table border="1"> <thead> <tr> <th></th> <th>S_x</th> <th>$\frac{b}{T}$</th> <th>$\frac{d}{T}$</th> <th>T</th> <th></th> </tr> </thead> <tbody> <tr> <td>UB 254 x 102 x 28</td> <td>353 cm³</td> <td>4.04</td> <td>35.7</td> <td>10.0 mm</td> <td>Appendix C</td> </tr> <tr> <td>UB 254 x 146 x 31</td> <td>393 cm³</td> <td>7.26</td> <td>36.5</td> <td>8.6 mm</td> <td>Appendix B</td> </tr> <tr> <td>UB 305 x 102 x 28</td> <td>403 cm³</td> <td>4.58</td> <td>46.0</td> <td>7.8 mm</td> <td>Appendix A</td> </tr> </tbody> </table>		S_x	$\frac{b}{T}$	$\frac{d}{T}$	T		UB 254 x 102 x 28	353 cm ³	4.04	35.7	10.0 mm	Appendix C	UB 254 x 146 x 31	393 cm ³	7.26	36.5	8.6 mm	Appendix B	UB 305 x 102 x 28	403 cm ³	4.58	46.0	7.8 mm	Appendix A	
	S_x	$\frac{b}{T}$	$\frac{d}{T}$	T																						
UB 254 x 102 x 28	353 cm ³	4.04	35.7	10.0 mm	Appendix C																					
UB 254 x 146 x 31	393 cm ³	7.26	36.5	8.6 mm	Appendix B																					
UB 305 x 102 x 28	403 cm ³	4.58	46.0	7.8 mm	Appendix A																					
	Member Selected = UB 254 x 102 x 28																									
	Strength Classification																									
Table 9 BS 5950	T = 10 mm (< 16 mm, so $p_y = 275$ N/mm ²)	$p_y = 275$ N/mm ²																								
Table 11 BS 5950	$\epsilon = \sqrt{\frac{275}{p_y}} = \epsilon = \sqrt{\frac{275}{275}} = \epsilon = 1$	$\epsilon = 1$																								
	Section Classification																									
Table 11 BS 5950	$\frac{b}{T} = 4.04 < 9\epsilon = 9 = \text{flange is Plastic}$																									
	$\frac{d}{T} = 35.7 < 80\epsilon = 80 = \text{Web is Plastic}$																									
	UB 254 x 102 x 28 Section is Class 1 Plastic																									
	Shear Strength																									
	As $\frac{d}{T} = 35.7 < 70\epsilon = 70$, Shear Buckling is not considered																									
	Shear Capacity of Section (P_v)																									
	$P_v = 0.6 p_y A_v = 0.6 p_y t D \quad P_v = 0.6 \times 275 \times 6.3 \times 260.4$																									
	$P_v = 270.7 \times 10^3 \text{ N} = P_v = 270.7 \text{ kN}$	$P_v = 270.7 \text{ kN}$																								

	Project		Name	Date
	InSite Project No.		By	TM
	Client Project No.		Chk'd	
	Document No.		App'd	
	Calculation Title	Member A	Sheet	4 of 5
Reference	Calculation			Output
	Check $F_v < 0.6P_v$ $74\text{kN} < 0.6 \times 270.7$ $74\text{kN} < 162.42\text{kN} = \text{Low Shear Load}$			
	Bending Moment Moment Capacity of Section (M_c) $M_c = P_y S_x = 275 \times 353 \times 10^3 = M_c = 97.1 \times 10^6 \text{ N.mm}$ $M_c = 97.1 \text{ kNm}$			$M_c = 97.1 \text{ kNm}$
	Extra Moment due to Self Weight (M_{sw}) $M_{sw} = \frac{1.4(28 \times 10)^2}{8} \quad M_{sw} = 1.23 \text{ kNm}$			$M_{sw} = 1.23 \text{ kNm}$
	Total Moment (M_t) $M_t = M + M_{sw} = M_t = 92.5 + 1.23$ $M_t = 93.73 \text{ kNm}$			$M_t = 93.73 \text{ kNm}$
	Check $M_t < M_c$ $93.73 < 97.1 = \text{OK}$			
	Deflection Check (Δ_{max}) $\Delta_{max} = \frac{5WL^3}{384EI}$ $W = wL = 8 \text{ kN/m} \times 5 \text{ m} = 40 \text{ kN}$ $E = 205 \text{ kN/mm}^2 = 205 \times 10^6 \text{ kN/m}^2$ $I(I_x) = 4000 \text{ cm}^4 = 40 \times 10^{-6} \text{ m}^4$ $\Delta_{max} = \frac{5 \times 40 \times 5^3}{384 \times 205 \times 10^6 \times 40 \times 10^{-6}} = \Delta_{max} = 0.00794 \text{ m}$ $\Delta_{max} = 7.94 \text{ mm}$			$\Delta_{max} = 7.94 \text{ mm}$

4) Structural Analysis of Member B

	Project		Name	Date
	InSite Project No.		By	T M
	Client Project No.		Chk'd	
	Document No.		App'd	
	Calculation Title	Member B	Sheet	1 of 4
Reference	Calculation		Output	
	Load acting on Secondary Member:- Area acting on Member:- $6m \times 2m$ $= 12m^2$ Total Dead Load (g_k) = $6kN/m^2 \times 2m$ $= 12kN/m$ Total Imposed Load (q_k) = $4kN/m^2 \times 2m$ $= 8kN/m$ Ultimate Load (w) = $1.4g_k + 1.6q_k$ $= 1.4 \times 12 + 1.6 \times 8$ $= 29.6kN/m$ Design Moment & Shear Maximum Moment at Midspan (M) $M = \frac{wl^2}{8} = M = \frac{29.6kN/m \times 6m^2}{8} = M = \frac{1065.6}{8}$ $M = 133.2kNm$  Maximum Shear at R_A & R_B $R_A = R_B = \frac{wl}{2} = \frac{29.6 \times 6}{2} = \frac{177.6}{2}$ $R_A = R_B = 88.8kN$		$g_k = 12kN/m$ $q_k = 8kN/m$ $w = 29.6kN/m$ $M = 133.2kNm$ $R_A = R_B = 88.8kN$	
				

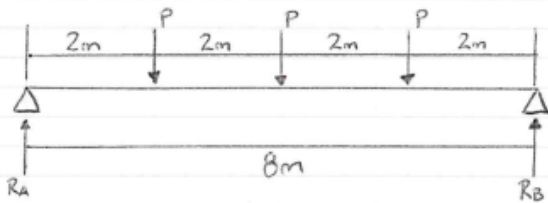
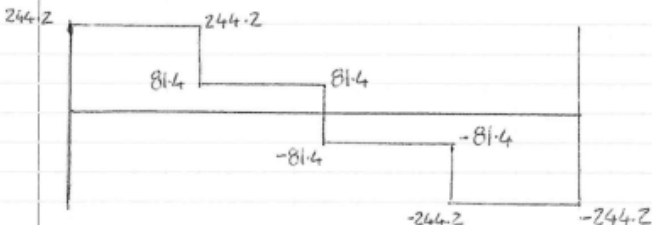
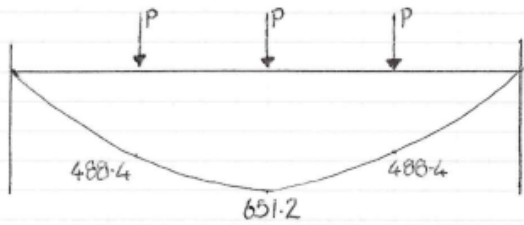
	Project		Name	
	InSite Project No.		By	TM
	Client Project No.		Chk'd	
	Document No.		App'd	
	Calculation Title	Member B	Sheet	2 of 4

Reference	Calculation	Output																				
	 Initial Member Selection Steel Grade (p_y) = 275 N/mm² $M_c = p_y S_x \Rightarrow S_x \geq \frac{M}{p_y} = S_x \geq \frac{133.2 \text{ kN}}{275 \text{ N/mm}^2}$ $S_x \geq \frac{133.2 \times 10^6}{275} = S_x \geq 484.36 \text{ cm}^3$																					
BS EN 10025	Initial Member Selection <table border="1"> <thead> <tr> <th></th> <th>S_x</th> <th>$\frac{b}{T}$</th> <th>$\frac{d}{T}$</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>UB 254x146x43</td> <td>566</td> <td>4.92</td> <td>30.4</td> <td>12.7</td> </tr> <tr> <td>UB 305x127x37</td> <td>539</td> <td>4.60</td> <td>37.4</td> <td>10.7</td> </tr> <tr> <td>UB 305x165x40</td> <td>623</td> <td>6.92</td> <td>44.2</td> <td>10.2</td> </tr> </tbody> </table> Appendix E Selected Appendix F - Check Appendix D		S_x	$\frac{b}{T}$	$\frac{d}{T}$	T	UB 254x146x43	566	4.92	30.4	12.7	UB 305x127x37	539	4.60	37.4	10.7	UB 305x165x40	623	6.92	44.2	10.2	
	S_x	$\frac{b}{T}$	$\frac{d}{T}$	T																		
UB 254x146x43	566	4.92	30.4	12.7																		
UB 305x127x37	539	4.60	37.4	10.7																		
UB 305x165x40	623	6.92	44.2	10.2																		
Table 6 BS 5950	Strength Classification $T = 10.7 \text{ mm} (< 16 \text{ mm, so } p_y = 275 \text{ N/mm}^2) = E = 1$	E = 1																				
Table 11 BS 5950	Section Classification $\frac{b}{T} = 4.60 < 9E = 9 = \text{flange is Plastic}$ $\frac{d}{T} = 37.4 < 80E = 80 = \text{Web is Plastic}$ UB 305x127x37 is Class 1 Plastic																					
	Shear Strength As $\frac{d}{T} = 37.4 < 70E = 70$, Shear Buckling Not Considered																					

	Project		Name	Date
	InSite Project No.		By	TM
	Client Project No.		Chk'd	
	Document No.		App'd	
	Calculation Title	Member B	Sheet	3 of 4
Reference	Calculation		Output	
	Shear Capacity of Section (P_v) $P_v = 0.6 P_y t D = P_v = 0.6 \times 275 \times 7.1 \times 304.4$ $P_v = 356.6 \text{ kN}$ Check $F_v < P_v$ $88.8 \text{ kN} < 213.96 \text{ kN} = \text{Low Shear Load}$		$P_v = 356.6 \text{ kN}$	
	Bending Moment $M_c = P_y S_x = M_c = 275 \times 539 \times 10^3$ $M_c = 148.23 \text{ kNm}$		$M_c = 148.23 \text{ kNm}$	
	Extra Moment due to Self-Weight (M_{sw}) $M_{sw} = \frac{1.4 (37 \times 10)^2}{8} = M_{sw} = 2.33 \text{ kNm}$		$M_{sw} = 2.33 \text{ kNm}$	
	Total Moment (M_t) $M_t = M + M_{sw} = M_t = 133.2 \text{ kNm} + 2.33 \text{ kNm}$ $M_t = 135.53 \text{ kNm}$ Check $M_t < M_c$ $135.53 < 148.23 = \text{OK}$		$M_t = 135.53 \text{ kNm}$	
	Deflection Check (Δ_{max}) $\Delta_{max} = \frac{5WL^3}{384EI}$ $W = wL = 8 \text{ kN/m} \times 6 \text{ m} = 48 \text{ kN}$ $E = 205 \text{ kN/mm}^2 = 205 \times 10^6 \text{ kN/m}^2$ $I = 7170 \text{ cm}^4 = 71.7 \times 10^{-6} \text{ m}^4$ $\Delta_{max} = \frac{5 \times 48 \times 6^3}{384 \times 205 \times 10^6 \times 71.7 \times 10^{-6}} = \Delta_{max} = 0.00918 \text{ m}$ $\Delta_{max} = 9.18 \text{ mm}$		$\Delta_{max} = 9.18 \text{ mm}$	

	Project		Name	Date																
	InSite Project No.		By	TM																
	Client Project No.		Chk'd																	
	Document No.		App'd																	
	Calculation Title	Member B	Sheet	4 of 4																
Reference	Calculation		Output																	
Table 8 BS 5950	Calculate Deflection Limit Beams Carrying Plaster = $\text{Span} / 360$ $= 6 \times 10^3 / 360$ $= 16.67 \text{mm}$ Check $\Delta_{\text{max}} < \text{Deflection Limit}$ $9.18 \text{mm} < 16.67 \text{mm} = \text{OK}$ UB 305x127x37 is a Suitable Section		$\delta = 16.67 \text{mm}$																	
	<table border="1"> <thead> <tr> <th></th> <th>Design Limit</th> <th>Provided</th> <th>Utilisation %</th> </tr> </thead> <tbody> <tr> <td>Shear</td> <td>88.8kN</td> <td>213.96kN</td> <td>41.50 %</td> </tr> <tr> <td>Bending</td> <td>135.53kNm</td> <td>148.23kNm</td> <td>91.43 %</td> </tr> <tr> <td>Deflection</td> <td>9.18mm</td> <td>16.67mm</td> <td>55.01 %</td> </tr> </tbody> </table>					Design Limit	Provided	Utilisation %	Shear	88.8kN	213.96kN	41.50 %	Bending	135.53kNm	148.23kNm	91.43 %	Deflection	9.18mm	16.67mm	55.01 %
	Design Limit	Provided	Utilisation %																	
Shear	88.8kN	213.96kN	41.50 %																	
Bending	135.53kNm	148.23kNm	91.43 %																	
Deflection	9.18mm	16.67mm	55.01 %																	

5) Structural Analysis of Member C

	Project		Name	Date
	InSite Project No.		By	TM
	Client Project No.		Chk'd	
	Document No.		App'd	
	Calculation Title	Member C	Sheet	1 of 4
Reference	Calculation			Output
	Loads acting on Member C  $P = \text{Reaction from Member A \& Member B}$ $P = 74\text{ kN} + 88.8\text{ kN} = P = 162.8\text{ kN} \quad P = 162.8\text{ kN}$ Design Shear & Moment Maximum Shear $R_A = R_B = \frac{3P}{2} = \frac{3 \times 162.8}{2}$ $R_A = R_B = 244.2\text{ kN} \quad R_A = R_B = 244.2\text{ kN}$  Maximum Moment at Mid-Span (M) $M = R\left(\frac{L}{2}\right) - P\left(\frac{L}{2} - a\right) = M = 244.2\left(\frac{8}{2}\right) - 162.8\left(\frac{8}{2} - 2\right)$ $M = 976.8 - 325.6 = M = 651.2\text{ kNm} \quad M = 651.2\text{ kNm}$ 			

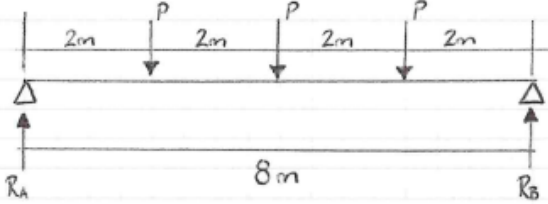
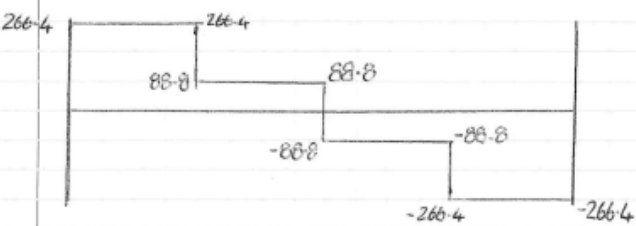
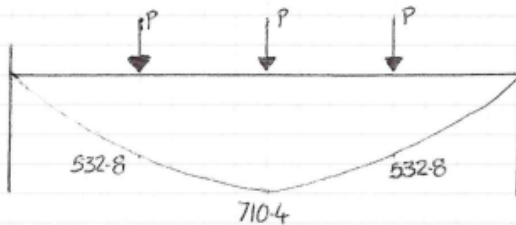
	Project		Name	Date		
	InSite Project No.		By	T.M		
	Client Project No.		Chk'd			
	Document No.		App'd			
	Calculation Title	Member C	Sheet	2 of 4		
Reference	Calculation			Output		
BS EN 10025	Member Selection					
	S_x	T	$\frac{b}{T}$	$\frac{d}{T}$		
	UB 533x312x151	4150	20.3	6.75	37.5	Appendix G
	UB 610x305x149	4590	19.7	6.6	45.8	Appendix H
	UB 533x312x182	5040	24.4	5.61	31.3	Appendix I
	UB 610x305x179	5550	23.6	5.51	38.3	Appendix J - Check
	Member Selected = UB 610x305x179					
	Strength Classification					
Table 9 BS 5950	$T = 23.6$ (16mm - 40mm, so $P_y = 265$)			$P_y = 265 \text{ N/mm}^2$		
Table 11 BS 5950	$E = \frac{\sqrt{275}}{P_y} = E = \frac{\sqrt{275}}{265} = E = 1.02$			$E = 1.02$		
	Section Classification					
Table 11 BS 5950	$\frac{b}{T} = 5.51 < 9E = 9.17 = \text{flange is Plastic}$					
	$\frac{d}{T} = 38.3 < 80E = 81.6 = \text{Web is Plastic}$					
	UB 610x305x179 is Class 1 Plastic					
	Shear Strength					
	As $\frac{d}{T} = 38.3 < 70E = 71.4$, Shear Buckling Not Considered					
	Shear Capacity of Section (P_v)					
	$P_v = 0.6 P_y t D = P_v = 0.6 \times 265 \times 14.1 \times 620.2$					
	$P_v = 1390.43 \text{ kN}$			$P_v = 1390.43 \text{ kN}$		
	Check $F_v < 0.6 P_v$					
	$244.2 \text{ kN} < 834.26 \text{ kN} = \text{Low Shear Load}$					

	Project		Name	Date
	InSite Project No.		By	TM
	Client Project No.		Chk'd	
	Document No.		App'd	
	Calculation Title	Member C	Sheet	3 of 4
Reference	Calculation		Output	
Table 13 BS 5950	Both flanges free to rotate on plan $L_E = 1.0 L_T$ $L_E = 8m$ Buckling Resistance ($M_x \leq M_b$) $M_x = M + M_{sw}$ $M_{sw} = \frac{1.4 (179 \times 10)^8^2}{8} = M_{sw} = \frac{160,384}{8}$ $M_{sw} = 20.05 kNm$ $M_x = M + M_{sw} = M_x = 651.2 kNm + 20.05 kNm$ $M_x = 671.25 kNm$		$M_{sw} = 20.05 kNm$ $M_x = 671.25 kNm$	
Table 20 BS 5950	$M_b = p_b S_x$ for Class 1 Plastic p_b is obtained from Table 20, BS 5950: λ is given by = $\sqrt{b_w} (L_E / r_y) = \sqrt{1.0} \times \frac{8 \times 10^3}{7.07 \times 10} = 113.15$ $\frac{D}{T} = \frac{620.2}{23.6} = 26.28$ Using Interpolation from Table 20, BS 5950 (2) 5275, thickness 16-40) $p_b = 145.17 N/mm^2$ $M_b = p_b S_x = M_b = 145.17 \times 5550 \times 10^3 = M_b = 805.69 \times 10^6$ $M_b = 805.69 kNm$ Check $M_x \leq M_b$ $671.25 \leq 805.69 = OK$		$p_b = 145.17 N/mm^2$	

	Project		Name	Date
	InSite Project No.		By	TM
	Client Project No.		Chk'd	
	Document No.		App'd	
	Calculation Title	Member C	Sheet	4 of 4

Reference	Calculation	Output																
	Deflection Check (Δ_{max}) $\Delta_{max} = \frac{5WL^3}{384EI}$ $W = 3P = 3 \times 162.8 = 488.4 \text{ kN}$ $E = 205 \text{ kN/mm}^2 = 205 \times 10^6 \text{ N/m}^2$ $I(x_x) = 153000 \text{ cm}^4 = 1530 \times 10^{-6} \text{ m}^4$ $\Delta_{max} = \frac{5 \times 488.4 \times 8^3}{384 \times 205 \times 10^6 \times 1530 \times 10^{-6}} = \Delta_{max} = 0.0104 \text{ m}$ $\Delta_{max} = 10.4 \text{ mm}$ $\Delta_{max} = 10.4 \text{ mm}$ Calculate Deflection Limit Table 8 BS 5950 Beams carrying plaster = Span / 360 $= 8 \times 10^3 / 360$ $= 22.22 \text{ mm}$ $\delta = 22.22 \text{ mm}$ Check $\Delta_{max} < \text{Deflection Limit}$ $10.4 \text{ mm} < 22.22 \text{ mm}$ UB610x305x179 is a suitable Section																	
	<table border="1"> <thead> <tr> <th></th> <th>Design Limit</th> <th>Provided</th> <th>Utilisation %</th> </tr> </thead> <tbody> <tr> <td>Shear</td> <td>244.2 kN</td> <td>834.26 kN</td> <td>29.27 %</td> </tr> <tr> <td>Bending</td> <td>671.25 kNm</td> <td>805.69 kNm</td> <td>83.31 %</td> </tr> <tr> <td>Deflection</td> <td>10.4 mm</td> <td>22.22 mm</td> <td>46.80 %</td> </tr> </tbody> </table>		Design Limit	Provided	Utilisation %	Shear	244.2 kN	834.26 kN	29.27 %	Bending	671.25 kNm	805.69 kNm	83.31 %	Deflection	10.4 mm	22.22 mm	46.80 %	
	Design Limit	Provided	Utilisation %															
Shear	244.2 kN	834.26 kN	29.27 %															
Bending	671.25 kNm	805.69 kNm	83.31 %															
Deflection	10.4 mm	22.22 mm	46.80 %															

6) Structural Analysis of Member D

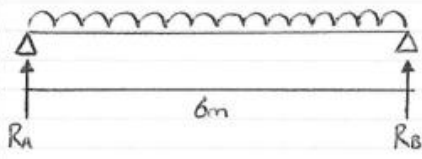
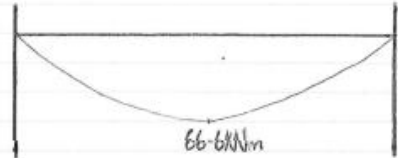
	Project		Name	Date
	InSite Project No.		By	TH
	Client Project No.		Chk'd	
	Document No.		App'd	
	Calculation Title	Member D	Sheet	1 of 3
Reference	Calculation		Output	
	Loads acting on Member D  $P = 2 \times \text{Reaction from Member B}$ $P = 2 \times 88.8 \text{ kN} \quad P = 177.6 \text{ kN} \quad P = 177.6 \text{ kN}$ Design Moment & Shear Maximum Shear $R_A = R_B = \frac{3P}{2} = \frac{3 \times 177.6 \text{ kN}}{2}$ $R_A = R_B = 266.4 \text{ kN} \quad R_A = R_B = 266.4 \text{ kN}$  Maximum Moment at Mid-Span (M) $M = R\left(\frac{L}{2}\right) - P\left(\frac{L}{2} - a\right) = M = 266.4 \text{ kN} \left(\frac{8}{2}\right) - 177.6 \left(\frac{8}{2} - 2\right)$ $M = 1065.6 - 355.2 = M = 710.4 \text{ kNm} \quad M = 710.4 \text{ kNm}$ 			

	Project		Name	Date								
	InSite Project No.		By	TM								
	Client Project No.		Chk'd									
	Document No.		App'd									
	Calculation Title	Member D	Sheet	2 of 3								
Reference	Calculation		Output									
Table 9 BS 5950 Table 11	Member Selection											
		<table><tr><th>S_x</th><th>T</th><th>$\frac{b}{T}$</th><th>$\frac{d}{T}$</th></tr><tr><td>5550</td><td>23.6</td><td>5.51</td><td>38.3</td></tr></table>	S_x	T	$\frac{b}{T}$	$\frac{d}{T}$	5550	23.6	5.51	38.3	Appendix K -Check	
	S_x	T	$\frac{b}{T}$	$\frac{d}{T}$								
	5550	23.6	5.51	38.3								
	Member Selected = UB 610x305x179											
	The same member used for Member C, so											
	Strength Classification = $P_y = 265\text{N/mm}^2$		$P_y = 265\text{N/mm}^2$									
	Section Classification = Class 1 Plastic											
	Shear Strength = Not Considered ($<70\%$)											
	Shear Capacity = $P_v = 1390.43\text{kN}$		$P_v = 1390.43\text{kN}$									
	Buckling Resistance = $M_b = 805.69\text{kNm}$		$M_b = 805.69\text{kNm}$									
	Effective Length the Same as Member C = $L_E = 8\text{m}$		$L_E = 8\text{m}$									
Deflection Limit (δ) = 22mm		$\delta = 22\text{mm}$										
Check Shear $F_v < 0.6 P_v$												
$266.4\text{kN} < 834.26\text{kN} = \text{Low Shear Load}$												
Buckling Resistance ($M_x \leq M_b$)												
$M_x = M + M_{sw} = M_x = 710.4 + 20.05 = M_x = 730.45$		$M_x = 730.45\text{kNm}$										
$M_{sw} = \text{Taken from Member C (20.05kNm)}$												
Check $M_x \leq M_b = 730.45\text{kNm} \leq 805.69\text{kNm} = \text{OK}$												

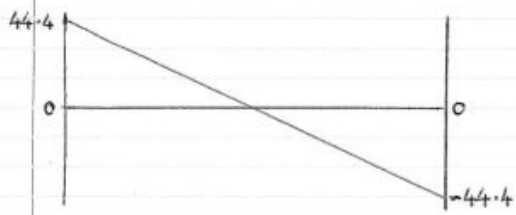
	Project		Name	
	InSite Project No.		By	TM
	Client Project No.		Chk'd	
	Document No.		App'd	
	Calculation Title	Member D	Sheet	3 of 3

Reference	Calculation	Output																
	Deflection Check (Δ_{max}) $\Delta_{max} = \frac{5WL^3}{384EI}$ $W = 3P = 3 \times 177.6 \text{ kN} = 532.8 \text{ kN}$ $E = 205 \times 10^6 \text{ kN/m}$ $I(x) = 1530 \times 10^{-6} \text{ m}^4$ $\Delta_{max} = \frac{5 \times 532.8 \times 8^3}{384 \times 205 \times 10^6 \times 1530 \times 10^{-6}} = \Delta_{max} = 0.01132 \text{ m}$ $\Delta_{max} = 11.32 \text{ mm}$ $\Delta_{max} = 11.32 \text{ mm}$ Check $\Delta_{max} < \text{Deflection Limit } (\delta)$ $11.32 \text{ mm} < 22.22 \text{ mm} = \text{OK}$ UB 610 x 305 x 179 is a suitable section <table border="1"> <thead> <tr> <th></th> <th>Design Limit</th> <th>Provided</th> <th>Utilisation %</th> </tr> </thead> <tbody> <tr> <td>Shear</td> <td>266.4 kN</td> <td>834.26 kN</td> <td>31.93 %</td> </tr> <tr> <td>Bending</td> <td>730.45 kNm</td> <td>805.69 kNm</td> <td>90.66 %</td> </tr> <tr> <td>Deflection</td> <td>11.32 mm</td> <td>22.22 mm</td> <td>50.95 %</td> </tr> </tbody> </table>		Design Limit	Provided	Utilisation %	Shear	266.4 kN	834.26 kN	31.93 %	Bending	730.45 kNm	805.69 kNm	90.66 %	Deflection	11.32 mm	22.22 mm	50.95 %	
	Design Limit	Provided	Utilisation %															
Shear	266.4 kN	834.26 kN	31.93 %															
Bending	730.45 kNm	805.69 kNm	90.66 %															
Deflection	11.32 mm	22.22 mm	50.95 %															

7) Structural Analysis of Member E

	Project		Name	Date
	InSite Project No.		By	TM
	Client Project No.		Chk'd	
	Document No.		App'd	
	Calculation Title	Member E	Sheet	1 of 4
Reference	Calculation		Output	
	Loads acting on Member E Dead Load (g_k) = 6 kN/m^2 Imposed Load (q_k) = 4 kN/m^2 Area acting on Member E = $6\text{ m} \times 1\text{ m} = 6\text{ m}^2$ Total Dead Load (g_k) = $6\text{ kN/m}^2 \times 1\text{ m}$ $= 6\text{ kN/m}$ $g_k = 6\text{ kN/m}$ Total Imposed Load (q_k) = $4\text{ kN/m}^2 \times 1\text{ m}$ $= 4\text{ kN/m}$ $q_k = 4\text{ kN/m}$  Calculate Ultimate Load (W) $W = 1.4g_k + 1.6q_k$ $W = 1.4 \times 6 + 1.6 \times 4 = W = 8.4 + 6.4$ $W = 14.8\text{ kN/m}$ $W = 14.8\text{ kN/m}$ Design of Moment & Shear $M = \frac{wl^2}{8} = M = \frac{14.8 \times 6^2}{8} = M = \frac{532.8}{8}$ $M = 66.6\text{ kNm}$ $M = 66.6\text{ kNm}$ 			

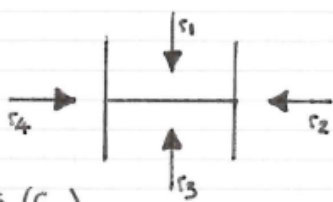
	Project		Name	Date
	InSite Project No.		By	TM
	Client Project No.		Chk'd	
	Document No.		App'd	
	Calculation Title	Member E	Sheet	2 of 4

Reference	Calculation	Output																				
	Maximum Shear at R_A & $R_B = \frac{wl}{2}$ $R_A = R_B = \frac{14.8 \times 6}{2} = R_A = R_B = \frac{88.8}{2}$ $R_A = R_B = 44.4 \text{ kN}$  Initial Member Selection Steel Grade (P_y) = 275 N/mm^2 $M_c = P_y S_x \Rightarrow S_x \geq \frac{M}{P_y} = S_x \geq \frac{66.6 \text{ kNm}}{275 \text{ N/mm}^2}$ $S_x \geq \frac{66.6 \times 10^6}{275} = S_x = 242.18 \text{ cm}^3$	$R_A = R_B = 44.4 \text{ kN}$																				
BS EN 10025	Initial Member Selection <table border="1"> <thead> <tr> <th></th> <th>S_x</th> <th>T</th> <th>$\frac{b}{T}$</th> <th>$\frac{d}{T}$</th> </tr> </thead> <tbody> <tr> <td>UB 254x102x22</td> <td>259</td> <td>6.8</td> <td>5.93</td> <td>39.5</td> </tr> <tr> <td>UB 203x102x23</td> <td>234</td> <td>9.3</td> <td>4.37</td> <td>31.4</td> </tr> <tr> <td>UB 178x102x19</td> <td>171</td> <td>7.9</td> <td>5.14</td> <td>30.6</td> </tr> </tbody> </table> Member Selected = UB 254x102x22 Strength Classification $T = 6.8 \text{ mm}$ ($< 16 \text{ mm}$, so $P_y = 275 \text{ N/mm}^2$) $E = \frac{\sqrt{275}}{P_y} = E = \frac{\sqrt{275}}{275} = E = 1$		S_x	T	$\frac{b}{T}$	$\frac{d}{T}$	UB 254x102x22	259	6.8	5.93	39.5	UB 203x102x23	234	9.3	4.37	31.4	UB 178x102x19	171	7.9	5.14	30.6	Appendix - N - Check Appendix - M Appendix - L
	S_x	T	$\frac{b}{T}$	$\frac{d}{T}$																		
UB 254x102x22	259	6.8	5.93	39.5																		
UB 203x102x23	234	9.3	4.37	31.4																		
UB 178x102x19	171	7.9	5.14	30.6																		
Table 9 BS 5950 Table 11	$P_y = 275 \text{ N/mm}^2$ $E = 1$	$P_y = 275 \text{ N/mm}^2$ $E = 1$																				

	Project		Name	Date
	InSite Project No.		By	TM
	Client Project No.		Chk'd	
	Document No.		App'd	
	Calculation Title	Member E	Sheet	3 of 4
Reference	Calculation			Output
Table 11 BS 5950	Section Classification			
	$\frac{b}{t} = 5.93 < 9\epsilon = 9 = \text{flange is plastic}$			
	$\frac{d}{t} = 39.5 < 80\epsilon = 80 = \text{Web is plastic}$			
	UB 254x102x22 is Class 1 Plastic			
	Shear Strength			
	As $\frac{d}{t} = 39.5 < 70\epsilon = 70$, Shear Buckling is not considered			
	Shear Capacity of Section (P_v)			
	$P_v = 0.6 p_y t D = P_v = 0.6 \times 275 \times 5.7 \times 254$			
	$P_v = 238.89 \times 10^3 \text{ N/mm} \quad P_v = 238.89 \text{ kN}$			$P_v = 238.89 \text{ kN}$
	Check $F_v < 0.6 P_v = 44.4 \text{ kN} < 0.6 \times 238.89 \text{ kN}$			
	$= \text{OK} \quad = 44.4 \text{ kN} < 143.33 \text{ kN} = \text{OK}$			
	Bending Moment			
	Moment Capacity of Section (M_c)			
	$M_c = p_y S_x = M_c = 275 \times 259 \times 10^3 = M_c = 71.23 \text{ kNm}$			$M_c = 71.23 \text{ kNm}$
	Extra Moment due to Self Weight (M_{sw})			
	$M_{sw} = \frac{1.4 (22 \times 10) 6^2}{8} = M_{sw} = 1.39 \text{ kNm}$			$M_{sw} = 1.39 \text{ kNm}$
	Total Moment (M_t)			
	$M_t = M + M_{sw} = M_t = 66.6 \text{ kNm} + 1.39 \text{ kNm}$			
	$M_t = 67.99 \text{ kNm}$			$M_t = 67.99 \text{ kNm}$
	Check $M_t < M_c$			
	$67.99 \text{ kNm} < 71.23 \text{ kNm} = \text{OK}$			

	Project		Name	Date																
	InSite Project No.		By	TM																
	Client Project No.		Chk'd																	
	Document No.		App'd																	
	Calculation Title	Member E	Sheet	4 of 4																
Reference	Calculation		Output																	
	Deflection Check (Δ_{max}) $\Delta_{max} = \frac{5WL^3}{384EI}$ $W = wL = 4kN/m \times 6m = 24kN$ $E = 205 \times 10^6 kN/m^2$ $I(x_x) = 2840cm^4 = 28.4 \times 10^{-6} m^4$ $\Delta_{max} = \frac{5 \times 24 \times 6^3}{384 \times 205 \times 10^6 \times 28.4 \times 10^{-6}} = \Delta_{max} = 0.01159$ $\Delta_{max} = 11.6mm$ $\Delta_{max} = 11.6mm$ Calculate Deflection Limit Table 8 BS 5950 Beams Carrying Plaster = $\frac{Span}{360}$ $= \frac{6 \times 10^3}{360}$ $= 16.67mm$ $\delta = 16.67mm$ Check $\Delta_{max} < \text{Deflection Limit } (\delta)$ $11.6mm < 16.67mm = OK$ UB 254x102x22 is a suitable section <table border="1"> <thead> <tr> <th></th> <th>Design Limit</th> <th>Provided</th> <th>Utilisation %</th> </tr> </thead> <tbody> <tr> <td>Shear</td> <td>44.4kN</td> <td>143.33kN</td> <td>30.98%</td> </tr> <tr> <td>Bending</td> <td>67.99kNm</td> <td>71.23kNm</td> <td>95.45%</td> </tr> <tr> <td>Deflection</td> <td>11.6mm</td> <td>16.67mm</td> <td>69.59%</td> </tr> </tbody> </table>			Design Limit	Provided	Utilisation %	Shear	44.4kN	143.33kN	30.98%	Bending	67.99kNm	71.23kNm	95.45%	Deflection	11.6mm	16.67mm	69.59%		
	Design Limit	Provided	Utilisation %																	
Shear	44.4kN	143.33kN	30.98%																	
Bending	67.99kNm	71.23kNm	95.45%																	
Deflection	11.6mm	16.67mm	69.59%																	

8) Structural Analysis of Column A

	Project		Name	Date
	InSite Project No.		By	TM
	Client Project No.		Chk'd	
	Document No.		App'd	
	Calculation Title	Column A (Gridline C2)	Sheet	1 of 4
Reference	Calculation			Output
	Loads applied to Column A at Level 1			
	reaction from Member A: $r_1 = 74\text{kN}$			
	" " " $C = r_2 = 244.2\text{kN}$			
	" " " $B = r_3 = 88.8\text{kN}$			
	" " " $C = r_4 = 244.2\text{kN}$			
				
	Axial Load from Level 2 - Level 5 (f_{2-5})			
	$= (r_1 + r_2 + r_3 + r_4) \times 4 =$			
	$= (74 + 244.2 + 88.8 + 244.2) \times 4 = 651.2 \times 4 = 2604.8\text{kN}$			
	Total Axial Load (f_c) = $f_{2-5} + r_1 + r_2 + r_3 + r_4$			
	$f_c = 2604.8\text{kN} + 74 + 244.2 + 88.8 + 244.2$			
	$f_c = 3256\text{kN}$			$f_c = 3256\text{kN}$
	Member Selection			
	UC 254x254x107	Z_y 458	S_x 1480	A_g 136
	UC 305x305x97	479	1590	123
	UC 305x305x118	589	1960	150
				Appendix O
				Appendix P
				← Selected Appendix Q
	Member Selected = 305x305x118 UC			
	Section Classification			
Table 11 BS 5950	$T = 18.7\text{mm}$ ($16\text{mm} < 40\text{mm}$, so $p_y = 265\text{N/mm}^2$)			$p_y = 265\text{N/mm}^2$
Table 11 BS 5950	$E = \sqrt{\frac{275}{p_y}} = E = \sqrt{\frac{275}{265}} = E = 1.02$			$E = 1.02$

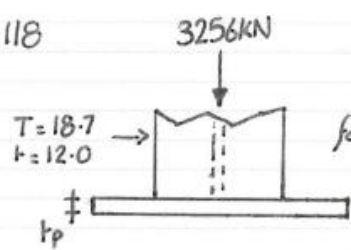
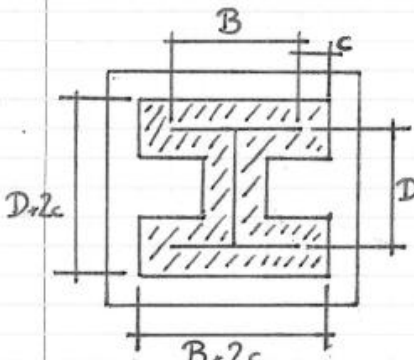
		Project		Name	Date
		InSite Project No.		By	TM
		Client Project No.		Chk'd	
		Document No.		App'd	
		Calculation Title	Column A (Gridline C2)	Sheet	2 of 4
Reference	Calculation			Output	
Table 11 BS 5950	$\frac{b}{T} = 7.09 < 9E = 9.18 = \text{flange is Plastic}$ $\frac{d}{t} = 20.6 < \frac{80E}{1+r_1} = \frac{81.6}{2} = 40.8 = \text{Web is Plastic}$ $r_1 = \frac{f_c}{d \cdot p_{yw}} = r_1 = \frac{3256 \times 10^3}{307.4 \times 12 \times 265} = r_1 = 3.33$ but $-1 < r_1 < 1$, so $r_1 = 3.33 > 1 = r_1 = 1$			$r_1 = 1$	
	UC 305x305x118 is Class 1 Plastic Effective Length (L_E) About x-x axis : $L_{Ex} = 0.85L = L_{Ex} = 0.85 \times 4000$ $L_{Ex} = 3400\text{mm}$			$L_{Ex} = 3400\text{mm}$	
Table 22 BS 5950	About y-y axis : $L_{Ey} = 1L = L_{Ey} = 1 \times 4000$ $L_{Ey} = 4000\text{mm}$			$L_{Ey} = 4000\text{mm}$	
Table 23 BS 5950	Compressive Strength (P_c) x-x axis obtained from table 24(b) y-y axis obtained from table 24(c) Slenderness : $\lambda_x = L_{Ex}/r_x = 3.4 \times 10^3 / 13.6 \times 10$ $\lambda_x = 25$ $\lambda_y = L_{Ey}/r_y = 4 \times 10^3 / 7.77 \times 10$ $\lambda_y = 51.48$				
	Using interpolation from Table 24(b) : $P_{cx} = 254 \text{ N/mm}^2$ Table 24(c) : $P_{cy} = 208.78 \text{ N/mm}^2$				

	Project		Name	Date
	InSite Project No.		By	TM
	Client Project No.		Chk'd	
	Document No.		App'd	
	Calculation Title	Column A (Gridline C2)	Sheet	3 of 4
Reference	Calculation		Output	
	Critical Compressive Strength (P_c) = 254 N/mm^2 Check Compression Resistance = $F_c \leq P_c$ ($P_c = A_g P_c$) $P_c = 150 \times 10^2 \times 254 \times 10^{-3} = P_c = 3810 \text{ kN}$ $P_c = 3810 \text{ kN}$ $F_c = 3256 \text{ kN} \leq P_c = 3810 \text{ kN} = \text{OK}$ Nominal Moment due to eccentricity Because the moment is equal on both side of the flanges $M_{2x} = 0$ Total Moment at level 1 from beams connected to the web $M_{2y} = (R_1 - R_3) (l/2 + 100) = (74 - 88.8) (12/2 + 100) \times 10^{-3}$ $M_{2y} = 1.63 \text{ kNm}$ Moment Distribution Stiffness of Column between Level 0 to Level 1 = $EI/4$ Level 1 to Level 2 = $EI/3.5$ ratio of Stiffness Value = $\frac{4}{3.5}$ there fore $\frac{3.5}{7.5}$ of M_{2x} and M_{2y} transfered to Column 0-1 So, $M_{x(0-1)} = \frac{3.5}{7.5} M_{2x} = \frac{3.5}{7.5} \times 0 = 0 \text{ kNm}$ $M_{y(0-1)} = \frac{3.5}{7.5} M_{2y} = \frac{3.5}{7.5} \times 1.63 = M_{y(0-1)} = 0.76 \text{ kNm}$ $M_{y(0-1)} = 0.76 \text{ kNm}$			

	Project		Name	Date
	InSite Project No.		By	T.M
	Client Project No.		Chk'd	
	Document No.		App'd	
	Calculation Title	Column A (Gridline C2)	Sheet	4 of 4
Reference	Calculation		Output	
Table 16 BS 5950	Buckling Resistance			
	$\lambda_{LT} = 0.5 L / r_y = 0.5 \times 4 \times 10^3 / 7.77 \times 10$			
	$\lambda_{LT} = 25.74$			
	$P_b = 265 \text{ N/mm}^2$		$P_b = 265 \text{ N/mm}^2$	
	Buckling Resistance Moment Capacity of Column (M_{bs})			
	$M_{bs} = P_b S_x = M_{bs} = 265 \times 1960 \times 10^{-3}$			
	$M_{bs} = 519.4 \text{ kN.m}$		$M_{bs} = 519.4 \text{ kN.m}$	
	Check Buckling (Combined Axial Force & Moment)			
	$\frac{F_c}{P_c} + \frac{M_x}{M_{bs}} + \frac{M_y}{P_y Z_y} \leq 1.0$			
	$\frac{3256}{3810} + \frac{0}{519.4} + \frac{0.76}{265 \times 589 \times 10^{-3}} = 0.85 + 0 + 0.004$			
	$= 0.86 \leq 1 = \text{OK}$			
	UC 305x305x118 in S275 steel is a suitable Section			
		Design Limit	Provided	Utilisation %
	Compressive Resistance	3256 kN	3810 kN	85.46 %
	Buckling Resistance	0.86	1	86 %
	Column Flange Thicker than Connection Plate so assumed Sufficient.			

9) Structural Analysis of Base Plate - Column A

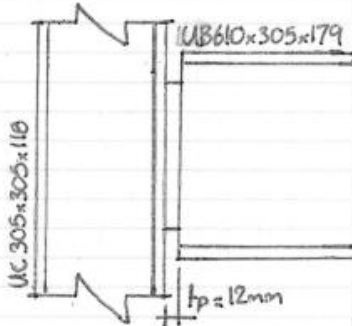
	Project		Name	Date
	InSite Project No.		By	T.M
	Client Project No.		Chk'd	
	Document No.		App'd	
	Calculation Title	Base Plate - 305x305x118 - Column A	Sheet	1 of 3

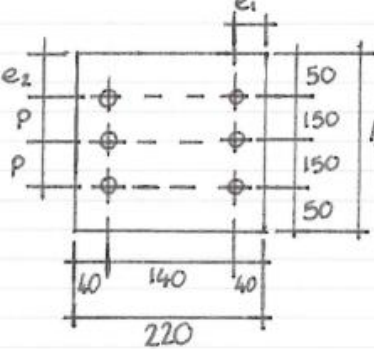
Reference	Calculation	Output
	Column Size = 305x305x118 Compression Characteristic Strength = $f_{cu} = 30 \text{ N/mm}^2$ Steel Grade = 5275 Effective Area, $(A_{eff}) \geq \frac{\text{Axial Load}}{\text{bearing Strength}}$ $A_{eff} = \frac{3256 \times 10^3}{0.6 \times 30}$ $A_{eff} = 1.81 \times 10^5 \text{ mm}^2$ $A_{eff} = 1.81 \times 10^5 \text{ mm}^2$   $D = 314.5 \text{ mm}$ $B = 307.4 \text{ mm}$ $t = 12.0 \text{ mm}$ $T = 18.7 \text{ mm}$ $A_{eff} = (D+2c)(B+2c) - 2 \left[\{D-2(c-T)\} \left\{ \frac{B-t}{2} \right\} \right] =$ $A_{eff} = 4c^2 + (2D+4B-2t)c + (2BT+Dt-2Tt) =$ $A_{eff} = 4c^2 + (2 \times 314.5 + 4 \times 307.4 - 2 \times 12.0)c + (2 \times 307.4 \times 18.7 + 314.5 \times 12.0 - 2 \times 18.7 \times 12.0)$ $A_{eff} = 4c^2 + 1,834.6c + 14,821.96$ Substituting $A_{eff} = 1.81 \times 10^5$ $1.81 \times 10^5 = 4c^2 + 1834.6c + 14,821.96 =$ $4c^2 + 1834.6c - 166,178.04 = 0$	

	Project		Name	Date
	InSite Project No.		By	TM
	Client Project No.		Chk'd	
	Document No.		App'd	
	Calculation Title	BasePlate - 305x305x118 - Column A	Sheet	2 of 3
Reference	Calculation			Output
	Solve for c = $c = \frac{-b \pm \sqrt{b^2 - 4ad}}{2a}$ $a = 4$ $b = 1834.6$ $d = -166178.04$ $c = \frac{-1834.6 \pm \sqrt{1834.6^2 - 4 \times 4 \times -166178.04}}{2 \times 4}$ $c = \frac{-1834.6 \pm \sqrt{3,363,556 + 2,658,848.64}}{8}$ $c = \frac{-1834.6 + 2454.06}{8}$ $c = \frac{619.46}{8}$ $c = 77.44 \text{ mm}$			
	Minimum Length of Baseplate = $D + 2c = 314.5 \text{ mm} + 2 \times 77.44$ $L_{\min} = 314.5 + 154.88$ $L_{\min} = 469.38 \text{ mm}$			$c = 77.44 \text{ mm}$ $L_{\min} = 469.38 \text{ mm}$
	Minimum Width of Baseplate = $B + 2c = 307.4 + 2 \times 77.44$ $W_{\min} = 307.4 + 154.88$ $W_{\min} = 462.28 \text{ mm}$			$W_{\min} = 462.28 \text{ mm}$
	Provide a 500 mm x 500 mm baseplate in grade 5275			$L_{\text{prov}} = 500 \text{ mm}$ $W_{\text{prov}} = 500 \text{ mm}$
	Check $A_{\text{provided}} > A_{\text{eff}}$ $500 \times 500 > 1.81 \times 10^5$ $2.50 \times 10^5 > 1.81 \times 10^5 = \text{OK}$			

	Project		Name	Date
	InSite Project No.		By	TM
	Client Project No.		Chk'd	
	Document No.		App'd	
	Calculation Title	Base Plate - 305x305x118 - Column A	Sheet	3 of 3
Reference	Calculation			Output
	Thickness of Base Plate (t_p) Assume Thickness = $16 < t_p \leq 40\text{mm}$ So design strength (P_{yp}) = 265N/mm^2 $t_p = c \left(\sqrt{\frac{3w}{P_{yp}}} \right) \quad w = 0.6 f_{cu}$ $t_p = 77.44 \left(\sqrt{\frac{3 \times 0.6 \times 30}{265}} \right)$ $t_p = 77.44 \left(\sqrt{\frac{54}{265}} \right)$ $t_p = 77.44 \times 0.45$ $t_p = 34.85\text{mm} \quad \text{Provide Minimum: } 35\text{mm} \quad t_p = 35\text{mm}$ Check: Base Plate thickness (t_p) > Column Flange thickness (T) = $35\text{mm} > 18.7\text{mm}$ Provide a Base Plate 500x500x35mm (Utilisation = 99.57%) Would recommend increasing plate thickness to 40mm to future proof the structure (Utilisation = 87.13%)			

10) Structural Analysis of Connection A – Member C to Column A

	Project		Name	Date
	InSite Project No.		By	TM
	Client Project No.		Chk'd	
	Document No.		App'd	
	Calculation Title	Connection A	Sheet	1 of 4
Reference	Calculation			Output
	End Plate Connection Steel Grade (P_y) = 275N/mm^2 ($= E=1$) Bolts (d_b) = M20, grade 8.8 Bolt Hole Diameter (D_h) = 22mm Plate Thickness (t_p) = 12mm			$E = 1$ $P_y = 275\text{N/mm}^2$ $d_b = 20\text{mm}$ $D_h = 22\text{mm}$ $t_p = 12\text{mm}$
	Bolt Spacing Minimum Pitch of Bolt (P_{min}) = $2.5d_b = 2.5 \times 20 = 50\text{mm}$ Maximum Pitch of Bolt (P_{max}) = $14t_p = 14 \times 12 = 168\text{mm}$ Therefore, $P_{min} \leq P \leq P_{max} = 50\text{mm} \leq P \leq 168\text{mm}$			$P_{min} = 50\text{mm}$ $P_{max} = 168\text{mm}$
	Edge/End Distance Minimum Edge/End Distance ($e_1 - e_2 \min$) = $1.4D_h = 1.4 \times 22\text{mm} = 30.8\text{mm}$ Maximum Edge/End Distance ($e_1 - e_2 \max$) = $11t_p E = 11 \times 12 \times 1 = 132\text{mm}$ Therefore, $e_1 - e_2 \min \leq e_1 - e_2 \leq e_1 - e_2 \max = 30.8\text{mm} \leq e_1 - e_2 \leq 132\text{mm}$			$e_1 - e_2 \min = 30.8\text{mm}$ $e_1 - e_2 \max = 132\text{mm}$
	Connection Details Column = UC 305x305x118 ↳ Backmark = 140mm ↳ Flange Thickness (T) = 18.7 Beam = UB 610x305x179 ↳ Depth = 620.2mm ↳ Web Thickness (t_w) = 14.1mm			

	Project		Name	Date
	InSite Project No.		By	TM
	Client Project No.		Chk'd	
	Document No.		App'd	
	Calculation Title	Connection A	Sheet	2 of 4
Reference	Calculation		Output	
	Proposed Connection  $P = 150\text{mm}$ $e_1 = 40\text{mm}$ $e_2 = 50\text{mm}$ $lp = 400\text{mm}$			
	Bolt Spacing = $P_{min} \leq P \leq P_{max} = 50\text{mm} \leq 150\text{mm} \leq 168\text{mm}$ = OK			
	Edge/End Distance = $e_1 - e_2 \min \leq e_1 - e_2 \leq e_1 - e_2 \max$ $= 30.8\text{mm} \leq 40 \& 50 \leq 132\text{mm}$ = OK			
	Bolt Group Strength			
	Shear Capacity of Bolt Group			
	6no. 20mm, grade 8.8 in Single Shear			
	From Bolt Capacities table			
	Single - Shear Value for 20mm diameter (P_s) = 91.9kN		$P_s = 91.9\text{kN}$	
	Shear Capacity of bolt group = $6P_s = 6 \times 91.9\text{kN}$ = 551.4kN		Shear Capacity = 551.4kN	
	Bearing Capacity			
	From Bolt Capacities table			
	For 20mm bolt and 12mm Plate (Minimum of P_{bb} & P_{bs}) = 110kN			
	Bearing Capacity of Connection = $6P_{bs} = 6 \times 110\text{kN}$ = 660kN		Bearing Capacity = 660kN	

	Project		Name	Date										
	InSite Project No.		By	T.M										
	Client Project No.		Chk'd											
	Document No.		App'd											
	Calculation Title	Connection A	Sheet	4 of 4										
Reference	Calculation		Output											
	Shear Strength of Beam Web at End Plate (P_{vb}) = $0.6 P_g A_v$ Where $A_v = 0.9 t_w l_p = A_v = 0.9 \times 14.1 \times 400$ $A_v = 5076 \text{ mm}^2$ $A_v = 5076 \text{ mm}^2$ $P_{vb} = 0.6 \times 275 \times 5076 = P_{vb} = 837,450 \text{ N}$ $P_{vb} = 837.45 \text{ kN}$ Shear Strength of Beam Web = 837.45 kN Summary of Results <table border="1" style="width: 100%;"> <tr> <td>Shear Capacity of Bolt Group</td> <td>551.4 kN</td> </tr> <tr> <td>Bearing Capacity of Connection</td> <td>660.0 kN</td> </tr> <tr> <td>Shear Capacity of End Plate assuming two failure Planes</td> <td>1190.4 kN</td> </tr> <tr> <td>Shear Strength of Weld</td> <td>785.3 kN</td> </tr> <tr> <td>Shear Strength of beam web at the end plate</td> <td>837.45 kN</td> </tr> </table> Strength of Connection is controlled by the Shear Capacity of Bolt Group which is 551.4 kN Check Connection Capacity > Shear from Member D 551.4 kN > 266.4 kN Connection is suitable with a Utilisation of 48.31%		Shear Capacity of Bolt Group	551.4 kN	Bearing Capacity of Connection	660.0 kN	Shear Capacity of End Plate assuming two failure Planes	1190.4 kN	Shear Strength of Weld	785.3 kN	Shear Strength of beam web at the end plate	837.45 kN		
Shear Capacity of Bolt Group	551.4 kN													
Bearing Capacity of Connection	660.0 kN													
Shear Capacity of End Plate assuming two failure Planes	1190.4 kN													
Shear Strength of Weld	785.3 kN													
Shear Strength of beam web at the end plate	837.45 kN													

Appendix A – Member A – UB254x146x31

Member Size

305x102x

28

D =	308.7	mm
T =	8.8	mm
t =	6	mm
b/T =	4.58	
d/t =	46	
ry (Radius of Gyration) =	2.08	
Sx (Plastic Modulus) =	403	cm ³
Ix (Second Moment of Area) =	53.7	m ⁴
		5370 cm ⁴
Beam Length =	5	m
Continuous Load	29.6	kN/m
Each Point Load	0	kN
Total Load on Beam =	148	kN
Unfactored Imposed Load	4	kN/m

Maximum Shear at Ra & Rb

Continuous load = 148 kNm

Point Load = 0.00 kNm

No. of Point load = 0

Total Shear = Ra = Rb = 74.00 kNm

Maximum Bending Moment at Mid Point

Bending Moment for Continuous Load = 92.5 kN

Bending Moment for Point Load = 0 kN

Point Load Distance
from Mid Point to
1st Point Load

a = 0

Total Bending Moment (M) = 92.5 kN

From Table 11, BS5950 = $\epsilon = \sqrt{Grade/Py}$

T = <16MM Py = 275

T = 16 - 40MM Py = 265

$\epsilon = 1.00$

b/T < 9 $\epsilon = 4.58 < 9.00$

d/t < 80 $\epsilon = 46 < 80.00$

Flange is plastic

Flange is plastic

Shear Strength

d/t < 70 $\epsilon = 46 < 70.00$

Shear Buckling is not
considered

Shear capacity of Section (Pv)

$$P_v = 0.6 P_y t D$$

$$305.61 \text{ kN}$$

$$\text{Check } F_v < 0.6 P_v$$

$$F_v =$$

$$74.00 \text{ kN}$$

$$0.6 P_v =$$

$$183.37 \text{ kN}$$

Low Shear Load

$$\text{Shear Capacity Utilisation} =$$

$$40.36\%$$

Moment Capacity of Section (Mc)

$$M_c = p_y S_x$$

$$110.83 \text{ kNm}$$

Additional Moment to Self Weight (Msw)

$$M_{sw} = 1.4 w l^2 / 8$$

$$1.23 \text{ kNm}$$

Total Moment (Mt)

$$M_t = M + M_{sw}$$

$$93.73$$

$$\text{Check } M_t < M_c$$

$$M_t$$

$$93.73 \text{ kN}$$

$$M_c$$

$$110.83 \text{ kN}$$

Section Suitable for
Moment Capacity

$$\text{Moment Capacity Utilisation} =$$

$$84.57\%$$

Deflection Check

$$E =$$

$$205$$

$$\Delta_{max} =$$

$$0.00296 \text{ m}$$

$$\Delta_{max} =$$

$$2.96 \text{ mm}$$

$$\text{Deflection Check} = \text{SPAN}/360 > \Delta_{max}$$

$$\text{SPAN}/360 =$$

$$13.89 \text{ mm}$$

$$\Delta_{max} =$$

$$3.0 \text{ mm}$$

SELECTION SUITABLE

$$\text{Deflection Utilisation} =$$

$$21.29\%$$

Appendix B – Member A – UB305x102x28

Member Size

254x146x

31

D =	251.4	mm
T =	8.6	mm
t =	6	mm
b/T =	7.26	
d/t =	36.5	
ry (Radius of Gyration) =	3.36	
Sx (Plastic Modulus) =	393	cm ³
Ix (Second Moment of Area) =	44.1	m ⁴
		4410 cm ⁴
Beam Length =	5	m
Continuous Load	29.6	kN/m
Each Point Load	0	kN
Total Load on Beam =	148	kN
Unfactored Imposed Load	4	kN/m

Maximum Shear at Ra & Rb

Continuous load = 148 kNm

Point Load = 0.00 kNm

No. of Point load = 0

Total Shear = Ra = Rb = 74.00 kNm

Maximum Bending Moment at Mid Point

Bending Moment for Continuous Load = 92.5 kN

Bending Moment for Point Load = 0 kN

Total Bending Moment (M) = 92.5 kN

Point Load Distance
from Mid Point to
1st Point Load
a = 0

From Table 11, BS5950 = $\epsilon = \sqrt{\text{Grade}/P_y}$

T = <16MM $P_y = 275$

T = 16 - 40MM $P_y = 265$

$\epsilon = 1.00$

b/T < 9 $\epsilon = 7.26 < 9.00$

d/t < 80 $\epsilon = 36.5 < 80.00$

Flange is plastic

Flange is plastic

Shear Strength

d/t < 70 $\epsilon = 36.5 < 70.00$

Shear Buckling is not
considered

Shear capacity of Section (Pv)

$$P_v = 0.6 P_y t D \quad 248.89 \text{ kN}$$

Check $F_v < 0.6 P_v$

$$F_v = 74.00 \text{ kN}$$
$$0.6 P_v = 149.33 \text{ kN}$$

Low Shear Load

$$\text{Shear Capacity Utilisation} = 49.55\%$$

Moment Capacity of Section (Mc)

$$M_c = p_y S_x \quad 108.08 \text{ kNm}$$

Additional Moment to Self Weight (Msw)

$$M_{sw} = 1.4 w l^2 / 8 \quad 1.36 \text{ kNm}$$

Total Moment (Mt)

$$M_t = M + M_{sw} \quad 93.86$$

Check $M_t < M_c$

$$M_t = 93.86 \text{ kN}$$
$$M_c = 108.08 \text{ kN}$$

Section Suitable for
Moment Capacity

$$\text{Moment Capacity Utilisation} = 86.84\%$$

Deflection Check

$$E = 205$$
$$\Delta_{max} = 0.00360 \text{ m}$$
$$\Delta_{max} = 3.60 \text{ mm}$$

Deflection Check = $SPAN/360 > \Delta_{max}$

$$SPAN/360 = 13.89 \text{ mm}$$
$$\Delta_{max} = 3.6 \text{ mm}$$

SELECTION SUITABLE

$$\text{Deflection Utilisation} = 25.93\%$$

Appendix C – Member A – UB254x102x28 - Check

Member Size

254x102x

28

D =	260.4	mm
T =	10	mm
t =	6.3	mm
b/T =	4.04	
d/t =	35.7	
r_y (Radius of Gyration) =	2.22	
S_x (Plastic Modulus) =	353	cm ³
I_x (Second Moment of Area) =	40	m ⁴
		4000 cm ⁴
Beam Length =	5	m
Continuous Load	29.6	kN/m
Each Point Load	0	kN
Total Load on Beam =	148	kN
Unfactored Imposed Load	4	kN/m

Maximum Shear at Ra & Rb

Continuous load = 148 kNm

Point Load = 0.00 kNm

No. of Point load = 0

Total Shear = Ra = Rb = 74.00 kNm

Maximum Bending Moment at Mid Point

Bending Moment for Continuous Load = 92.5 kN

Bending Moment for Point Load = 0 kN

Total Bending Moment (M) = 92.5 kN

Point Load Distance
from Mid Point to
1st Point Load
a = 0

From Table 11, BS5950 = $\varepsilon = \sqrt{Grade/Py}$

T = <16MM Py = 275

T = 16 - 40MM Py = 265

$\varepsilon = 1.00$

b/T < 9 ε = 4.04 < 9.00

d/t < 80 ε = 35.7 < 80.00

Flange is plastic

Flange is plastic

Shear Strength

d/t < 70 ε = 35.7 < 70.00

Shear Buckling is not
considered

Shear capacity of Section (Pv)

$$P_v = 0.6 P_y t D \quad 270.69 \text{ kN}$$

$$\text{Check } F_v < 0.6 P_v$$

$$F_v = 74.00 \text{ kN}$$
$$0.6 P_v = 162.41 \text{ kN}$$

Low Shear Load

$$\text{Shear Capacity Utilisation} = 45.56\%$$

Moment Capacity of Section (Mc)

$$M_c = p_y S_x \quad 97.08 \text{ kNm}$$

Additional Moment to Self Weight (Msw)

$$M_{sw} = 1.4 w l^2 / 8 \quad 1.23 \text{ kNm}$$

Total Moment (Mt)

$$M_t = M + M_{sw} \quad 93.73$$

$$\text{Check } M_t < M_c$$

$$M_t = 93.73 \text{ kN}$$
$$M_c = 97.08 \text{ kN}$$

Section Suitable for
Moment Capacity

$$\text{Moment Capacity Utilisation} = 96.55\%$$

Deflection Check

$$E = 205$$
$$\Delta_{max} = 0.00397 \text{ m}$$
$$\Delta_{max} = 3.97 \text{ mm}$$

$$\text{Deflection Check} = \text{SPAN}/360 > \Delta_{max}$$

$$\text{SPAN}/360 = 13.89 \text{ mm}$$
$$\Delta_{max} = 4.0 \text{ mm}$$

SELECTION SUITABLE

$$\text{Deflection Utilisation} = 28.58\%$$

Appendix D – Member B – UB305x165x40

Member Size

305x165x40

D =	303.4	mm
T =	10.2	mm
t =	6	mm
b/T =	6.92	
d/t =	44.2	
ry (Radius of Gyration) =	12.9	
Sx (Plastic Modulus) =	623	cm ³
Ix (Second Moment of Area) =	85	m ⁴
		8500 cm ⁴
Beam Length =	6	m
Continuous Load	29.6	kN/m
Each Point Load	0	kN
Total Load on Beam =	177.6	kN
Unfactored Imposed Load	4	kN/m

Maximum Shear at Ra & Rb

Continuous load = 177.6 kNm

Point Load = 0.00 kNm

No. of Point load = 0

Total Shear = Ra = Rb = 88.80 kNm

Maximum Bending Moment at Mid Point

Bending Moment for Continuous Load = 133.2 kN

Bending Moment for Point Load = 0 kN

Point Load Distance
from Mid Point to
1st Point Load
a = 0

Total Bending Moment (M) = 133.2 kN

From Table 11, BS5950 = $\epsilon = \sqrt{Grade/Py}$

T = <16MM Py = 275

T = 16 - 40MM Py = 265

$\epsilon = 1.00$

b/T < 9 ϵ = 6.92 < 9.00

d/t < 80 ϵ = 44.2 < 80.00

Flange is plastic

Flange is plastic

Shear Strength

d/t < 70 ϵ = 44.2 < 70.00

Shear Buckling is not
considered

Shear capacity of Section (Pv)

$$P_v = 0.6 P_y t D \quad 300.37 \text{ kN}$$

Check $F_v < 0.6 P_v$

$$\begin{aligned} F_v &= 88.80 \text{ kN} \\ 0.6 P_v &= 180.22 \text{ kN} \end{aligned}$$

Low Shear Load

$$\text{Shear Capacity Utilisation} = 49.27\%$$

Moment Capacity of Section (Mc)

$$M_c = p_y S_x \quad 171.33 \text{ kNm}$$

Additional Moment to Self Weight (Msw)

$$M_{sw} = 1.4 w l^2 / 8 \quad 2.52 \text{ kNm}$$

Total Moment (Mt)

$$M_t = M + M_{sw} \quad 135.72$$

Check $M_t < M_c$

$$\begin{aligned} M_t &= 135.72 \text{ kN} \\ M_c &= 171.33 \text{ kN} \end{aligned}$$

Section Suitable for
Moment Capacity

$$\text{Moment Capacity Utilisation} = 79.22\%$$

Deflection Check

$$\begin{aligned} E &= 205 \\ \Delta_{max} &= 0.00387 \text{ m} \\ \Delta_{max} &= 3.87 \text{ mm} \end{aligned}$$

Deflection Check = $SPAN/360 > \Delta_{max}$

$$\begin{aligned} SPAN/360 &= 16.67 \text{ mm} \\ \Delta_{max} &= 3.9 \text{ mm} \end{aligned}$$

SELECTION SUITABLE

$$\text{Deflection Utilisation} = 23.24\%$$

Appendix E – Member B – UB254x146x43

Member Size

254x146x43

D =	259.6	mm
T =	12.7	mm
t =	7.2	mm
b/T =	4.92	
d/t =	30.4	
ry (Radius of Gyration) =	10.9	
Sx (Plastic Modulus) =	566	cm ³
Ix (Second Moment of Area) =	65.4	m ⁴
		6540 cm ⁴
Beam Length =	6	m
Continuous Load	29.6	kN/m
Each Point Load	0	kN
Total Load on Beam =	177.6	kN
Unfactored Imposed Load	4	kN/m

Maximum Shear at Ra & Rb

Continuous load = 177.6 kNm

Point Load = 0.00 kNm

No. of Point load = 0

Total Shear = Ra = Rb = 88.80 kNm

Maximum Bending Moment at Mid Point

Bending Moment for Continuous Load = 133.2 kN

Bending Moment for Point Load = 0 kN

Point Load Distance
from Mid Point to
1st Point Load
a = 0

Total Bending Moment (M) = 133.2 kN

From Table 11, BS5950 = $\epsilon = \sqrt{Grade/Py}$

T = <16MM Py = 275 T = 16 - 40MM Py = 265

$\epsilon = 1.00$

b/T < 9 ϵ = 4.92 < 9.00

d/t < 80 ϵ = 30.4 < 80.00

Flange is plastic

Flange is plastic

Shear Strength

d/t < 70 ϵ = 30.4 < 70.00

Shear Buckling is not
considered

Shear capacity of Section (Pv)

$$P_v = 0.6 P_y t D \quad 308.40 \text{ kN}$$

Check $F_v < 0.6 P_v$

$$F_v = 88.80 \text{ kN}$$
$$0.6 P_v = 185.04 \text{ kN}$$

Low Shear Load

Shear Capacity Utilisation = 47.99%

Moment Capacity of Section (Mc)

$$M_c = p_y S_x \quad 155.65 \text{ kNm}$$

Additional Moment to Self Weight (Msw)

$$M_{sw} = 1.4 w l^2 / 8 \quad 2.71 \text{ kNm}$$

Total Moment (Mt)

$$M_t = M + M_{sw} \quad 135.91$$

Check $M_t < M_c$

$$M_t = 135.91 \text{ kN}$$
$$M_c = 155.65 \text{ kN}$$

**Section Suitable for
Moment Capacity**

Moment Capacity Utilisation = 87.32%

Deflection Check

$$E = 205$$
$$\Delta_{max} = 0.00503 \text{ m}$$
$$\Delta_{max} = 5.03 \text{ mm}$$

Deflection Check = $SPAN/360 > \Delta_{max}$

$$SPAN/360 = 16.67 \text{ mm}$$
$$\Delta_{max} = 5.0 \text{ mm}$$

SELECTION SUITABLE

Deflection Utilisation = 30.21%

Appendix F – Member B – UB305x127x37 - Check

Member Size

305x127x37

D =	304.4	mm
T =	10.7	mm
t =	7.1	mm
b/T =	4.6	
d/t =	37.4	
ry (Radius of Gyration) =	12.3	
Sx (Plastic Modulus) =	539	cm ³
Ix (Second Moment of Area) =	71.7	m ⁴
		7170 cm ⁴
Beam Length =	6	m
Continuous Load	29.6	kN/m
Each Point Load	0	kN
Total Load on Beam =	177.6	kN
Unfactored Imposed Load	4	kN/m

Maximum Shear at Ra & Rb

Continuous load = 177.6 kNm

Point Load = 0.00 kNm

No. of Point load = 0

Total Shear = Ra = Rb = 88.80 kNm

Maximum Bending Moment at Mid Point

Bending Moment for Continuous Load = 133.2 kN

Bending Moment for Point Load = 0 kN

Point Load Distance
from Mid Point to
1st Point Load
a = 0

Total Bending Moment (M) = 133.2 kN

From Table 11, BS5950 = $\epsilon = \sqrt{Grade/Py}$

T = <16MM Py = 275

T = 16 - 40MM Py = 265

$\epsilon = 1.00$

b/T < 9 ϵ = 4.6 < 9.00

d/t < 80 ϵ = 37.4 < 80.00

Flange is plastic

Flange is plastic

Shear Strength

d/t < 70 ϵ = 37.4 < 70.00

Shear Buckling is not
considered

Shear capacity of Section (Pv)

$$P_v = 0.6 P_y t D \quad 356.60 \text{ kN}$$

$$\text{Check } F_v < 0.6 P_v$$

$$F_v = 88.80 \text{ kN}$$
$$0.6 P_v = 213.96 \text{ kN}$$

Low Shear Load

$$\text{Shear Capacity Utilisation} = 41.50\%$$

Moment Capacity of Section (Mc)

$$M_c = p_y S_x \quad 148.23 \text{ kNm}$$

Additional Moment to Self Weight (Msw)

$$M_{sw} = 1.4 w l^2 / 8 \quad 2.33 \text{ kNm}$$

Total Moment (Mt)

$$M_t = M + M_{sw} \quad 135.53$$

$$\text{Check } M_t < M_c$$

$$M_t = 135.53 \text{ kN}$$
$$M_c = 148.23 \text{ kN}$$

Section Suitable for
Moment Capacity

$$\text{Moment Capacity Utilisation} = 91.44\%$$

Deflection Check

$$E = 205$$
$$\Delta_{max} = 0.00459 \text{ m}$$
$$\Delta_{max} = 4.59 \text{ mm}$$

$$\text{Deflection Check} = \text{SPAN}/360 > \Delta_{max}$$

$$\text{SPAN}/360 = 16.67 \text{ mm}$$
$$\Delta_{max} = 4.6 \text{ mm}$$

SELECTION SUITABLE

$$\text{Deflection Utilisation} = 27.55\%$$

Appendix G - Member C - UB533x312x151

Member Size

533x312x

151

D =	542.5	mm
T =	20.3	mm
t =	12.7	mm
b/T =	6.75	
d/t =	37.5	
ry (Radius of Gyration) =	7.32	
Sx (Plastic Modulus) =	4150	cm ³
Ix (Second Moment of Area) =	1010	101000 cm ⁴
Beam Length	8	m
Continuous Load	0	kN/m
Each Point Load	162.8	kN
Total Load on Beam	488.4	kN

Maximum Shear at Ra & Rb

Continuous load = 0 kNm

Point Load = 244.20 kNm

No. of Point load = 3

Total Shear = Ra = Rb = 244.20 kNm

Maximum Bending Moment at Mid Point

Bending Moment for Continuous Load = 0 kN

Bending Moment for Point Load = 651.2 kN

Distance from Mid
Point to 1st Point Load
(m)

a = 2

Total Bending Moment = 651.2 kN

From Table 11, BS5950 = $\epsilon = \sqrt{\text{Grade}/P_y}$

T = <16MM $P_y = 275$

T = 16 - 40MM $P_y = 265$

$\epsilon = 1.02$

b/T < 9 $\epsilon = 6.75 < 9.17$

d/t < 80 $\epsilon = 37.5 < 81.50$

Flange is plastic

Flange is plastic

Shear Strength

d/t < 70 $\epsilon = 20.3 < 71.31$

Shear Buckling is not considered

Shear capacity of Section (Pv)

$$P_v = 0.6 P_y t D = 1095.47 \text{ kN}$$

$$\text{Check } F_v < 0.6 P_v$$

$$F_v = 244.20 \text{ kN}$$

$$0.6 P_v = 657.28 \text{ kN}$$

Low Shear Load

$$\text{Shear Utilisation} = 37.15\%$$

Effective Length From Table 13, BS5950 - Both Flanges free to rotate on plan

$$L_E = 1.0 L L T = 8 \text{ m}$$

$$M_{sw} = 16.91 \text{ kNm}$$

$$M_x = 668.11 \text{ kNm}$$

$$M_b = p_b S_x \quad \text{For Plastic Section}$$

p_b obtained from Table 20, BS 5950:-

It is Given by:-

$$\sqrt{B_w (L_E / r_y)} = 109.29$$

$$D/T = 26.72$$

From Table 20, BS5950 (1)

$$P_b = 151.85 \text{ N/mm}^2$$

Interpolate if needed See Next Tab
"Table 20, BS 5950"

$$M_b = p_b S_x = 630.17 \text{ kNm}$$

$$\text{Check } M_x < M_b$$

$$M_x = 668.11$$

$$M_b = 630.17$$

Member Fails Under Lateral
Torsional Buckling

$$\text{Bending Utilisation} = 106.02\%$$

Deflection Check

$$E = 205$$

$$\Delta_{max} = 0.01573 \text{ m}$$

$$\Delta_{max} = 15.73 \text{ mm}$$

$$\text{Deflection Check} = \text{SPAN}/360 < \Delta_{max}$$

$$\text{SPAN}/360 = 22.22 \text{ mm}$$

$$\Delta_{max} = 15.73 \text{ mm}$$

SELECTION SUITABLE

$$\text{Deflection Utilisation} = 70.77\%$$

Appendix H - Member C - UB610x305x149

Member Size

610x305x149

D =	612.4	mm
T =	19.7	mm
t =	11.8	mm
b/T =	6.6	
d/t =	45.8	
r_y (Radius of Gyration) =	7	
S_x (Plastic Modulus) =	4590	cm ³
I_x (Second Moment of Area) =	1260	cm ⁴
Beam Length	8	m
Continuous Load	0	kN/m
Each Point Load	162.8	kN
Total Load on Beam	488.4	kN

Maximum Shear at Ra & Rb

Continuous load = 0 kNm

Point Load = 244.20 kNm

No. of Point load = 3

Total Shear = $R_a = R_b =$ 244.20 kNm

Maximum Bending Moment at Mid Point

Bending Moment for Continuous Load = 0 kN

Bending Moment for Point Load = 651.2 kN

Distance from Mid Point to 1st Point Load (m)

a = 2

Total Bending Moment = 651.2 kN

From Table 11, BS5950 = $\varepsilon = \sqrt{Grade/Py}$

T = <16MM Py = 275

T = 16 - 40MM Py = 265

$\varepsilon =$ 1.02

b/T < 9 $\varepsilon =$ 6.6 < 9.17

d/t < 80 $\varepsilon =$ 45.8 < 81.50

Flange is plastic

Flange is plastic

Shear Strength

d/t < 70 $\varepsilon =$ 19.7 < 71.31

Shear Buckling is not considered

Shear capacity of Section (Pv)

$$P_v = 0.6 P_y t D = 1148.98 \text{ kN}$$

$$\text{Check } F_v < 0.6 P_v$$

$$F_v = 244.20 \text{ kN}$$

$$0.6 P_v = 689.39 \text{ kN}$$

Low Shear Load

$$\text{Shear Utilisation} = 35.42\%$$

Effective Length From Table 13, BS5950 - Both Flanges free to rotate on plan

$$L_E = 1.0 L T = 8 \text{ m}$$

$$M_{sw} = 16.69 \text{ kNm}$$

$$M_x = 667.89 \text{ kNm}$$

$$M_b = p_b S_x \quad \text{For Plastic Section}$$

p_b obtained from Table 20, BS 5950:-

It is Given by:-

$$\sqrt{b_w (L_E / r_y)} = 114.29$$

$$D/T = 31.09$$

From Table 20, BS5950 (1)

$$p_b = 139.71 \text{ N/mm}^2$$

Interpolate if needed See Next Tab
"Table 20, BS 5950"

$$M_b = p_b S_x = 641.29 \text{ kNm}$$

$$\text{Check } M_x < M_b$$

$$M_x = 667.89$$

$$M_b = 641.29$$

Member Fails Under Lateral
Torsional Buckling

$$\text{Bending Utilisation} = 104.15\%$$

Deflection Check

$$E = 205$$

$$\Delta_{max} = 0.01261 \text{ m}$$

$$\Delta_{max} = 12.61 \text{ mm}$$

$$\text{Deflection Check} = \text{SPAN}/360 < \Delta_{max}$$

$$\text{SPAN}/360 = 22.22 \text{ mm}$$

$$\Delta_{max} = 12.61 \text{ mm}$$

SELECTION SUITABLE

$$\text{Deflection Utilisation} = 56.72\%$$

Appendix I - Member C - UB533x312x182

Member Size

533x312x182

D =	550.7	mm
T =	24.4	mm
t =	15.2	mm
b/T =	5.61	
d/t =	31.3	
ry (Radius of Gyration) =	7.4	
Sx (Plastic Modulus) =	5040	cm ³
Ix (Second Moment of Area) =	1230	cm ⁴
Beam Length	8	m
Continuous Load	0	kN/m
Each Point Load	162.8	kN
Total Load on Beam	488.4	kN

Maximum Shear at Ra & Rb

Continuous load = 0 kNm

Point Load = 244.20 kNm

No. of Point load = 3

Total Shear = Ra = Rb = 244.20 kNm

Maximum Bending Moment at Mid Point

Bending Moment for Continuous Load = 0 kNm

Bending Moment for Point Load = 651.2 kNm

Distance from Mid Point to 1st Point Load (m)

a = 2

Total Bending Moment = 651.2 kNm

From Table 11, BS5950 = $\epsilon = \sqrt{Grade/Py}$

T = <16MM Py = 275

T = 16 - 40MM Py = 265

$\epsilon = 1.02$

b/T < 9 ϵ = 5.61 < 9.17

d/t < 80 ϵ = 31.3 < 81.50

Flange is plastic

Flange is plastic

Shear Strength

d/t < 70 ϵ = 24.4 < 71.31

Shear Buckling is not considered

Shear capacity of Section (Pv)

$$P_v = 0.6 P_y t D = 1330.93 \text{ kN}$$

$$\text{Check } F_v < 0.6 P_v$$

$$F_v = 244.20 \text{ kN}$$

$$0.6 P_v = 798.56 \text{ kN}$$

Low Shear Load

$$\text{Shear Utilisation} = 30.58\%$$

Effective Length From Table 13, BS5950 - Both Flanges free to rotate on plan

$$L_E = 1.0 L_T = 8 \text{ m}$$

$$M_{sw} = 20.38 \text{ kNm}$$

$$M_x = 671.58 \text{ kNm}$$

$$M_b = p_b S_x \quad \text{For Plastic Section}$$

p_b obtained from Table 20, BS 5950:- It is Given by:-

$$\sqrt{B_w (L_E / r_y)} = 108.11$$

$$D/T = 22.57$$

From Table 20, BS5950 (1)

$$p_b = 163.43 \text{ N/mm}^2$$

Interpolate if needed See Next Tab
"Table 20, BS 5950"

$$M_b = p_b S_x = 823.70 \text{ kNm}$$

$$\text{Check } M_x < M_b$$

$$M_x = 671.58$$

$$M_b = 823.70$$

Section Suitable

$$\text{Bending Utilisation} = 81.53\%$$

Deflection Check

$$E = 205$$

$$\Delta_{max} = 0.01291 \text{ m}$$

$$\Delta_{max} = 12.91 \text{ mm}$$

$$\text{Deflection Check} = \text{SPAN}/360 < \Delta_{max}$$

$$\text{SPAN}/360 = 22.22 \text{ mm}$$

$$\Delta_{max} = 12.91 \text{ mm}$$

SELECTION SUITABLE

$$\text{Deflection Utilisation} = 58.11\%$$

Appendix J - Member C - UB610x305x179 - Check

Member Size

610x305x179

D =	620.2	mm
T =	23.6	mm
t =	14.1	mm
b/T =	5.51	
d/t =	38.3	
ry (Radius of Gyration) =	7.07	
Sx (Plastic Modulus) =	5550	cm ³
Ix (Second Moment of Area) =	1530	cm ⁴
Beam Length	8	m
Continuous Load	0	kN/m
Each Point Load	162.8	kN
Total Load on Beam	488.4	kN

Maximum Shear at Ra & Rb

Continuous load = 0 kNm

Point Load = 244.20 kNm

No. of Point load = 3

Total Shear = Ra = Rb = 244.20 kNm

Maximum Bending Moment at Mid Point

Bending Moment for Continuous Load = 0 kNm

Bending Moment for Point Load = 651.2 kNm

Distance from Mid Point to 1st Point Load (m)

a = 2

Total Bending Moment = 651.2 kNm

From Table 11, BS5950 = $\epsilon = \sqrt{\text{Grade}/P_y}$

T = <16MM Py = 275

T = 16 - 40MM Py = 265

$\epsilon = 1.02$

b/T < 9 ϵ = 5.51 < 9.17

d/t < 80 ϵ = 38.3 < 81.50

Flange is plastic

Flange is plastic

Shear Strength

d/t < 70 ϵ = 23.6 < 71.31

Shear Buckling is not considered

Shear capacity of Section (Pv)

$$P_v = 0.6 P_y t D = 1390.43 \text{ kN}$$

$$\text{Check } F_v < 0.6 P_v$$

$$F_v = 244.20 \text{ kN}$$

$$0.6 P_v = 834.26 \text{ kN}$$

Low Shear Load

$$\text{Shear Utilisation} = 29.27\%$$

Effective Length From Table 13, BS5950 - Both Flanges free to rotate on plan

$$L_E = 1.0 L L T = 8 \text{ m}$$

$$M_{sw} = 20.05 \text{ kNm}$$

$$M_x = 671.25 \text{ kNm}$$

$$M_b = p_b S_x \quad \text{For Plastic Section}$$

p_b obtained from Table 20, BS 5950:- It is Given by:-

$$\sqrt{B_w (L_E / r_y)} = 113.15$$

$$D/T = 26.28$$

From Table 20, BS5950 (1)

$$p_b = 148.17 \text{ N/mm}^2$$

Interpolate if needed See Next Tab
"Table 20, BS 5950"

$$M_b = p_b S_x = 822.33 \text{ kNm}$$

$$\text{Check } M_x < M_b$$

$$M_x = 671.25$$

$$M_b = 822.33$$

Section Suitable

$$\text{Bending Utilisation} = 81.63\%$$

Deflection Check

$$E = 205$$

$$\Delta_{max} = 0.01038 \text{ m}$$

$$\Delta_{max} = 10.38 \text{ mm}$$

$$\text{Deflection Check} = \text{SPAN}/360 < \Delta_{max}$$

$$\text{SPAN}/360 = 22.22 \text{ mm}$$

$$\Delta_{max} = 10.38 \text{ mm}$$

SELECTION SUITABLE

$$\text{Deflection Utilisation} = 46.71\%$$

Appendix K - Member D - UB610x305x179 - Check

Member Size 610x305x179

D =	620.2	mm
T =	23.6	mm
t =	14.1	mm
b/T =	5.51	
d/t =	38.3	
ry (Radius of Gyration) =	7.07	
Sx (Plastic Modulus) =	5550	cm ³
Ix (Second Moment of Area) =	1530	153000 cm ⁴
Beam Length	8	m
Continuous Load	0	kN/m
Each Point Load	177.6	kN
Total Load on Beam	532.8	kN

Maximum Shear at Ra & Rb

Continuous load = 0 kNm
Point Load = 266.40 kNm

No. of Point load = 3

Total Shear = Ra = Rb = 266.40 kNm

Maximum Bending Moment at Mid Point

Bending Moment for Continuous Load = 0 kN
Bending Moment for Point Load = 710.4 kN

Distance from Mid Point to 1st Point Load (m)

a = 2

Total Bending Moment = 710.4 kN

From Table 11, BS5950 = $\epsilon = \sqrt{\text{Grade}/P_y}$

T = <16MM Py = 275

T = 16 - 40MM Py = 265

$\epsilon = 1.02$

b/T < 9 ϵ = 5.51 < 9.17

d/t < 80 ϵ = 38.3 < 81.50

Flange is plastic

Flange is plastic

Shear Strength

d/t < 70 ϵ = 23.6 < 71.31

Shear Buckling is not considered

Shear capacity of Section (Pv)

$$P_v = 0.6 P_y t D = 1390.43 \text{ kN}$$

$$\text{Check } F_v < 0.6 P_v$$

$$F_v = 266.40 \text{ kN}$$

$$0.6 P_v = 834.26 \text{ kN}$$

Low Shear Load

$$\text{Shear Utilisation} = 31.93\%$$

Effective Length From Table 13, BS5950 - Both Flanges free to rotate on plan

$$L_E = 1.0 L L T = 8 \text{ m}$$

$$M_{sw} = 20.05 \text{ kNm}$$

$$M_x = 730.45 \text{ kNm}$$

$$M_b = p_b S_x \quad \text{For Plastic Section}$$

p_b obtained from Table 20, BS 5950:- It is Given by:-

$$\sqrt{B_w (L_E / r_y)} = 113.15$$

$$D/T = 26.28$$

From Table 20, BS5950 (1)

$$p_b = 148.17 \text{ N/mm}^2$$

Interpolate if needed See Next Tab
"Table 20, BS 5950"

$$M_b = p_b S_x = 822.33 \text{ kNm}$$

$$\text{Check } M_x < M_b$$

$$M_x = 730.45$$

$$M_b = 822.33$$

Section Suitable

$$\text{Bending Utilisation} = 88.83\%$$

Deflection Check

$$E = 205$$

$$\Delta_{max} = 0.01132 \text{ m}$$

$$\Delta_{max} = 11.32 \text{ mm}$$

$$\text{Deflection Check} = \text{SPAN}/360 < \Delta_{max}$$

$$\text{SPAN}/360 = 22.22 \text{ mm}$$

$$\Delta_{max} = 11.32 \text{ mm}$$

SELECTION SUITABLE

$$\text{Deflection Utilisation} = 50.96\%$$

Appendix L - Member E - UB178x102x19

Member Size

178x102x

19

D =	177.8	mm
T =	7.9	mm
t =	4.8	mm
b/T =	5.14	
d/t =	30.6	
ry (Radius of Gyration) =	7.48	
Sx (Plastic Modulus) =	171	cm ³
Ix (Second Moment of Area) =	13.6	m ⁴
		1360 cm ⁴
Beam Length =	6	m
Continuous Load	14.8	kN/m
Each Point Load	0	kN
Total Load on Beam =	88.8	kN
Unfactored Imposed Load	4	kN/m

Maximum Shear at Ra & Rb

Continuous load = 88.8 kNm

Point Load = 0.00 kNm

No. of Point load = 0

Total Shear = Ra = Rb = 44.40 kNm

Maximum Bending Moment at Mid Point

Bending Moment for Continuous Load = 66.6 kN

Bending Moment for Point Load = 0 kN

Point Load Distance
from Mid Point to
1st Point Load
a = 0

Total Bending Moment (M) = 66.6 kN

From Table 11, BS5950 = $\epsilon = \sqrt{\text{Grade}/P_y}$

T = <16MM $P_y = 275$

T = 16 - 40MM $P_y = 265$

$\epsilon = 1.00$

b/T < 9 $\epsilon = 5.14 < 9.00$

d/t < 80 $\epsilon = 30.6 < 80.00$

Flange is plastic

Flange is plastic

Shear Strength

d/t < 70 $\epsilon = 30.6 < 70.00$

Shear Buckling is not
considered

Shear capacity of Section (Pv)

$$P_v = 0.6 P_y t D \quad 140.82 \text{ kN}$$

$$\text{Check } F_v < 0.6 P_v$$

$$F_v = 44.40 \text{ kN}$$
$$0.6 P_v = 84.49 \text{ kN}$$

Low Shear Load

$$\text{Shear Capacity Utilisation} = 52.55\%$$

Moment Capacity of Section (Mc)

$$M_c = p_y S_x \quad 47.03 \text{ kNm}$$

Additional Moment to Self Weight (Msw)

$$M_{sw} = 1.4 w l^2 / 8 \quad 1.20 \text{ kNm}$$

Total Moment (Mt)

$$M_t = M + M_{sw} \quad 67.80$$

$$\text{Check } M_t < M_c$$

$$M_t = 67.80 \text{ kN}$$
$$M_c = 47.03 \text{ kN}$$

Fails In Moment Capacity

$$\text{Moment Capacity Utilisation} = 144.17\%$$

Deflection Check

$$E = 205$$
$$\Delta_{max} = 0.02421 \text{ m}$$
$$\Delta_{max} = 24.21 \text{ mm}$$

$$\text{Deflection Check} = \text{SPAN}/360 > \Delta_{max}$$

$$\text{SPAN}/360 = 16.67 \text{ mm}$$
$$\Delta_{max} = 24.2 \text{ mm}$$

Fails in Deflection

$$\text{Deflection Utilisation} = 145.27\%$$

Appendix M - Member E - UB203x102x23

Member Size

203x102x **23**

D =	203.2	mm
T =	9.3	mm
t =	5.4	mm
b/T =	4.37	
d/t =	31.4	
ry (Radius of Gyration) =	8.46	
Sx (Plastic Modulus) =	234	cm ³
Ix (Second Moment of Area) =	21	m ⁴
		2100 cm ⁴
Beam Length =	6	m
Continuous Load	14.8	kN/m
Each Point Load	0	kN
Total Load on Beam =	88.8	kN
Unfactored Imposed Load	4	kN/m

Maximum Shear at Ra & Rb

Continuous load = 88.8 kNm

Point Load = 0.00 kNm

No. of Point load = **0**

Total Shear = Ra = Rb = **44.40** kNm

Maximum Bending Moment at Mid Point

Bending Moment for Continuous Load = 66.6 kN

Bending Moment for Point Load = 0 kN

Point Load Distance
from Mid Point to
1st Point Load
a = **0**

Total Bending Moment (M) = **66.6** kN

From Table 11, BS5950 = $\varepsilon = \sqrt{Grade/Py}$

T = <16MM Py = 275

T = 16 - 40MM Py = 265

$\varepsilon =$ 1.00

b/T < 9 ε = 4.37 < 9.00

d/t < 80 ε = 31.4 < 80.00

Flange is plastic

Flange is plastic

Shear Strength

d/t < 70 ε = 31.4 < 70.00

Shear Buckling is not
considered

Shear capacity of Section (Pv)

$$P_v = 0.6 P_y t D \quad 181.05 \text{ kN}$$

Check $F_v < 0.6 P_v$

$$F_v = 44.40 \text{ kN}$$
$$0.6 P_v = 108.63 \text{ kN}$$

Low Shear Load

Shear Capacity Utilisation = 40.87%

Moment Capacity of Section (Mc)

$$M_c = p_y S_x \quad 64.35 \text{ kNm}$$

Additional Moment to Self Weight (Msw)

$$M_{sw} = 1.4 w l^2 / 8 \quad 1.45 \text{ kNm}$$

Total Moment (Mt)

$$M_t = M + M_{sw} \quad 68.05$$

Check $M_t < M_c$

$$M_t = 68.05 \text{ kN}$$
$$M_c = 64.35 \text{ kN}$$

Fails In Moment Capacity

Moment Capacity Utilisation = 105.75%

Deflection Check

$$E = 205$$
$$\Delta_{max} = 0.01568 \text{ m}$$
$$\Delta_{max} = 15.68 \text{ mm}$$

Deflection Check = $SPAN/360 > \Delta_{max}$

$$SPAN/360 = 16.67 \text{ mm}$$
$$\Delta_{max} = 15.7 \text{ mm}$$

Selection Suitable

Deflection Utilisation = 94.08%

Appendix N - Member E - UB254x102x22 - Check

Member Size

254x102x **22**

D =	254	mm
T =	6.8	mm
t =	5.7	
b/T =	5.93	
d/t =	39.5	
r_y (Radius of Gyration) =	10.1	
S_x (Plastic Modulus) =	259	cm ³
I_x (Second Moment of Area) =	28.4	m ⁴
		2840 cm ⁴
Beam Length =	6	m
Continuous Load	14.8	kN/m
Each Point Load	0	kN
Total Load on Beam =	88.8	kN
Unfactored Imposed Load	4	kN/m

Maximum Shear at Ra & Rb

Continuous load = 88.8 kNm

Point Load = 0.00 kNm

No. of Point load = **0**

Total Shear = $R_a = R_b =$ **44.40** kNm

Maximum Bending Moment at Mid Point

Bending Moment for Continuous Load = 66.6 kNm

Bending Moment for Point Load = 0 kNm

Point Load Distance
from Mid Point to
1st Point Load

a = **0**

Total Bending Moment (M) = **66.6** kNm

From Table 11, BS5950 = $\epsilon = \sqrt{\text{Grade}/P_y}$

T = <16MM $P_y = 275$

T = 16 - 40MM $P_y = 265$

$\epsilon =$ 1.00

$b/T < 9\epsilon =$ 5.93 < 9.00

$d/t < 80\epsilon =$ 39.5 < 80.00

Flange is plastic

Flange is plastic

Shear Strength

$d/t < 70\epsilon =$ 39.5 < 70.00

Shear Buckling is not
considered

Shear capacity of Section (Pv)

$$P_v = 0.6 P_y t D \quad 238.89 \text{ kN}$$

$$\text{Check } F_v < 0.6 P_v$$

$$\begin{aligned} F_v &= 44.40 \text{ kN} \\ 0.6 P_v &= 143.33 \text{ kN} \end{aligned}$$

Low Shear Load

$$\text{Shear Capacity Utilisation} = 30.98\%$$

Moment Capacity of Section (Mc)

$$M_c = p_y S_x \quad 71.23 \text{ kNm}$$

Additional Moment to Self Weight (Msw)

$$M_{sw} = 1.4 w l^2 / 8 \quad 1.39 \text{ kNm}$$

Total Moment (Mt)

$$M_t = M + M_{sw} \quad 67.99$$

$$\text{Check } M_t < M_c$$

$$\begin{aligned} M_t &= 67.99 \text{ kN} \\ M_c &= 71.23 \text{ kN} \end{aligned}$$

Section Suitable for
Moment Capacity

$$\text{Moment Capacity Utilisation} = 95.45\%$$

Deflection Check

$$\begin{aligned} E &= 205 \\ \Delta_{max} &= 0.01159 \text{ m} \\ \Delta_{max} &= 11.59 \text{ mm} \end{aligned}$$

$$\text{Deflection Check} = \text{SPAN}/360 > \Delta_{max}$$

$$\begin{aligned} \text{SPAN}/360 &= 16.67 \text{ mm} \\ \Delta_{max} &= 11.6 \text{ mm} \end{aligned}$$

Selection Suitable

$$\text{Deflection Utilisation} = 69.56\%$$

Appendix O - Column A - UC254x254x107

Member Size

254x254x107

D =	266.7	mm
d =	258.8	mm
T =	20.5	mm
t =	12.8	mm
b/T =	5.38	mm
d/t =	15.6	mm
rx =	11.30	cm
ry =	6.59	cm
Zy (Elastic modulus) =	458	cm ³
Sx (Plastic modulus) =	1480	cm ³
Ag (Area of Section) =	136	cm ²
E =	205	kN/mm ²
Column Length Above	3.5	m
Column Length Below	4	m
Total Reaction on (x-x)	162.8	kN
Total Reaction on (y-y)	488.4	kN
Total Axial Load from above levels (Fh1/h2)	2604.8	kN

Number of Levels	
Above =	4
Reaction 1 (x-x) =	74
Reaction 2 (y-y) =	244.2
Reaction 3 (x-x) =	88.8
Reaction 4 (y-y) =	244.2

Calculate (Fc) = FH1/H2 + r1 + r2 + r3 + r4

Fc = 3256 kN

From Table 11, BS 5950 = $\varepsilon = \sqrt{275/P_y}$

T = <16MM Py = 275

T = 16 - 40MM Py = 265

$\varepsilon = 1.02$

10 $\varepsilon = 10.19$

b/T < 9 $\varepsilon = 5.38 < 9.17$

d/t < 80 $\varepsilon/1+r1 = 15.6 < 40.75$

Flange is plastic

Flange is plastic

r1 = Fc/ d t Pyw = 3.71 If r1 > 1 then use = 1

Effective Length

From Table 22, BS 5950

About x-x axis: Lex = 0.85L = 3400 mm

About y-y axis: Ley = 1L = 4000 mm

Compressive Strength (Pc)

From Table 23, BS 5950

$$\lambda = L_{ex}/r_x = 30.09 \quad P_{cx} = 248.91 \text{ N/mm}^2$$

$$\lambda = L_{ey}/r_y = 60.70 \quad P_{cy} = 194.95 \text{ N/mm}^2$$

$$\text{Critical Compressive Strength (p}_c\text{)} = 248.91 \text{ N/mm}^2$$

$$P_c = A_g p_c = 3385.20$$

Check Compressive Resistance = $F_c \leq P_c$

$$F_c \leq P_c \quad 3256 < 3385.20$$

Compressive Resistance is adequate

$$\text{Compressive Resistance Utilisation} = 96.18\%$$

Nominal Moment due to Eccentricity

$$M_{2x} = (R_2 - R_4) (t/2 + 100) = 0.00 \text{ kNm}$$

$$M_{2y} = (R_1 - R_3) (t/2 + 100) = 1.60 \text{ kNm}$$

Moment Distribution

$$M_{x(2-1)} = h_2 / (h_1 + h_2) \times M_{2x} = 0.00 \text{ kNm}$$

$$M_{y(2-1)} = h_2 / (h_1 + h_2) \times M_{2y} = 0.74 \text{ kNm}$$

Buckling Resistance

$$\lambda_{LT} = 0.5L/r_y = 30.35$$

Refer to Table 16, BS 5950

$$P_b = 265.00$$

Buckling resistance moment capacity of column ($M_{bs} = P_b S_x$)

$$M_{bs} = P_b S_x = 392.2$$

Check Buckling (Combined Axial Force & Moment)

$$\frac{F_c}{P_c} + \frac{M_x}{M_{bs}} + \frac{M_y}{P_y Z_y} = 0.97 \leq 1$$

Ok

$$\text{Buckling Utilisation} = 96.80\%$$

Appendix P - Column A - UC305x305x97

Member Size

305x305x97

D =	307.9	mm
d =	305.3	mm
T =	15.4	mm
t =	9.9	mm
b/T =	8.6	mm
d/t =	24.9	mm
r _x =	13.40	cm
r _y =	7.69	cm
Z _y (Elastic modulus) =	479	cm ³
S _x (Plastic modulus) =	1590	cm ³
A _g (Area of Section) =	123	cm ²
E =	205	kN/mm ²
Column Length Above	3.5	m
Column Length Below	4	m
Total Reaction on (x-x)	162.8	kN
Total Reaction on (y-y)	488.4	kN
Total Axial Load from above levels (F _{h1} /h ₂)	2604.8	kN

Number of Levels Above =	4
Reaction 1 (x-x) =	74
Reaction 2 (y-y) =	244.2
Reaction 3 (x-x) =	88.8
Reaction 4 (y-y) =	244.2

Calculate (F_c) = F_{H1}/H₂ + r₁ + r₂ + r₃ + r₄

F_c = 3256 kN

From Table 11, BS 5950 = $\varepsilon = \sqrt{275/P_y}$

T = <16MM P_y = 275 T = 16 - 40MM P_y = 265

$\varepsilon = 1.00$

10 $\varepsilon = 10.00$

b/T < 9 $\varepsilon = 8.6 < 9.00$
d/t < 80 $\varepsilon/1+r_1 = 24.9 < 40.00$

Flange is plastic

Flange is plastic

r₁ = F_c / d t P_{yw} = 3.92 If r₁ > 1 then use = 1

Effective Length

From Table 22, BS 5950

About x-x axis: L_{ex} = 0.85L = 3400 mm
About y-y axis: L_{ey} = 1L = 4000 mm

Compressive Strength (Pc)

From Table 23, BS 5950

$$\lambda = L_{ex}/r_x = 25.37 \quad P_{cx} = 253.63 \text{ N/mm}^2$$

$$\lambda = L_{ey}/r_y = 52.02 \quad P_{cy} = 207.98 \text{ N/mm}^2$$

$$\text{Critical Compressive Strength (pc)} = 253.63 \text{ N/mm}^2$$

$$P_c = A_g p_c = 3119.61$$

Check Compressive Resistance = $F_c \leq P_c$

$$F_c \leq P_c \quad 3256 < 3119.61$$

Fails Under Compressive Resistance

$$\text{Compressive Resistance Utilisation} = 104.37\%$$

Nominal Moment due to Eccentricity

$$M_{2x} = (R_2 - R_4) (t/2 + 100) = 0.00 \text{ kNm}$$

$$M_{2y} = (R_1 - R_3) (t/2 + 100) = 1.66 \text{ kNm}$$

Moment Distribution

$$M_x(2-1) = h_2/(h_1 + h_2) \times M_{2x} = 0.00 \text{ kNm}$$

$$M_y(2-1) = h_2/(h_1 + h_2) \times M_{2y} = 0.78 \text{ kNm}$$

Buckling Resistance

$$\lambda_{LT} = 0.5L/r_y = 26.01$$

Refer to Table 16, BS 5950

$$P_b = 265.00$$

Buckling resistance moment capacity of column ($M_{bs} = P_b S_x$)

$$M_{bs} = P_b S_x = 421.35$$

Check Buckling (Combined Axial Force & Moment)

$$\frac{F_c}{P_c} + \frac{M_x}{M_{bs}} + \frac{M_y}{P_y Z_y} = 1.05 \leq 1$$

Fails Under Buckling from Combined Axial Force & Moment

$$\text{Buckling Utilisation} = 104.96\%$$

Appendix Q - Column A - UC305x305x118 - Check

Member Size

305x305x118

D =	314.5	mm
d =	307.4	mm
T =	18.7	mm
t =	12	mm
b/T =	7.09	mm
d/t =	20.6	mm
r _x =	13.60	cm
r _y =	7.77	cm
Z _y (Elastic modulus) =	589	cm ³
S _x (Plastic modulus) =	1960	cm ³
A _g (Area of Section) =	150	cm ²
E =	205	kN/mm ²
Column Length Above	3.5	m
Column Length Below	4	m
Total Reaction on (x-x)	162.8	kN
Total Reaction on (y-y)	488.4	kN
Total Axial Load from above levels (F _{h1} /h ₂)	2604.8	kN

Number of Levels Above =	4
Reaction 1 (x-x) =	74
Reaction 2 (y-y) =	244.2
Reaction 3 (x-x) =	88.8
Reaction 4 (y-y) =	244.2

Calculate (F_c) = F_{H1}/H₂ + r₁ + r₂ + r₃ + r₄

F_c = 3256 kN

From Table 11, BS 5950 = $\epsilon = \sqrt{275/P_y}$

T = <16MM P_y = 275

T = 16 - 40MM P_y = 265

ϵ = 1.02

10 ϵ = 10.19

b/T < 9 ϵ = 7.09 < 9.17
d/t < 80 ϵ /1+r₁ = 20.6 < 40.75

Flange is plastic

Flange is plastic

r₁ = F_c / d t P_{yw} = 3.33 If r₁ > 1 then use = 1

Effective Length

From Table 22, BS 5950

About x-x axis: L_{ex} = 0.85L = 3400 mm
About y-y axis: L_{ey} = 1L = 4000 mm

Compressive Strength (Pc)

From Table 23, BS 5950

$$\lambda = L_{ex}/r_x = 25.00 \quad P_{cx} = 254.00 \text{ N/mm}^2$$

$$\lambda = L_{ey}/r_y = 51.48 \quad P_{cy} = 208.78 \text{ N/mm}^2$$

$$\text{Critical Compressive Strength (pc)} = 254.00 \text{ N/mm}^2$$

$$P_c = A_g p_c = 3810.00$$

Check Compressive Resistance = $F_c \leq P_c$

$$F_c \leq P_c \quad 3256 < 3810.00$$

Compressive Resistance is adequate

$$\text{Compressive Resistance Utilisation} = 85.46\%$$

Nominal Moment due to Eccentricity

$$M_{2x} = (R_2 - R_4) (t/2 + 100) = 0.00 \text{ kNm}$$

$$M_{2y} = (R_1 - R_3) (t/2 + 100) = 1.63 \text{ kNm}$$

Moment Distribution

$$M_x(2-1) = h_2/(h_1 + h_2) \times M_{2x} = 0.00 \text{ kNm}$$

$$M_y(2-1) = h_2/(h_1 + h_2) \times M_{2y} = 0.76 \text{ kNm}$$

Buckling Resistance

$$\lambda_{LT} = 0.5L/r_y = 25.74$$

Refer to Table 16, BS 5950

$$P_b = 265.00$$

Buckling resistance moment capacity of column ($M_{bs} = P_b S_x$)

$$M_{bs} = P_b S_x = 519.4$$

Check Buckling (Combined Axial Force & Moment)

$$\frac{F_c}{P_c} + \frac{M_x}{M_{bs}} + \frac{M_y}{P_y Z_y} = 0.86 \leq 1$$

Ok

$$\text{Buckling Utilisation} = 85.95\%$$